

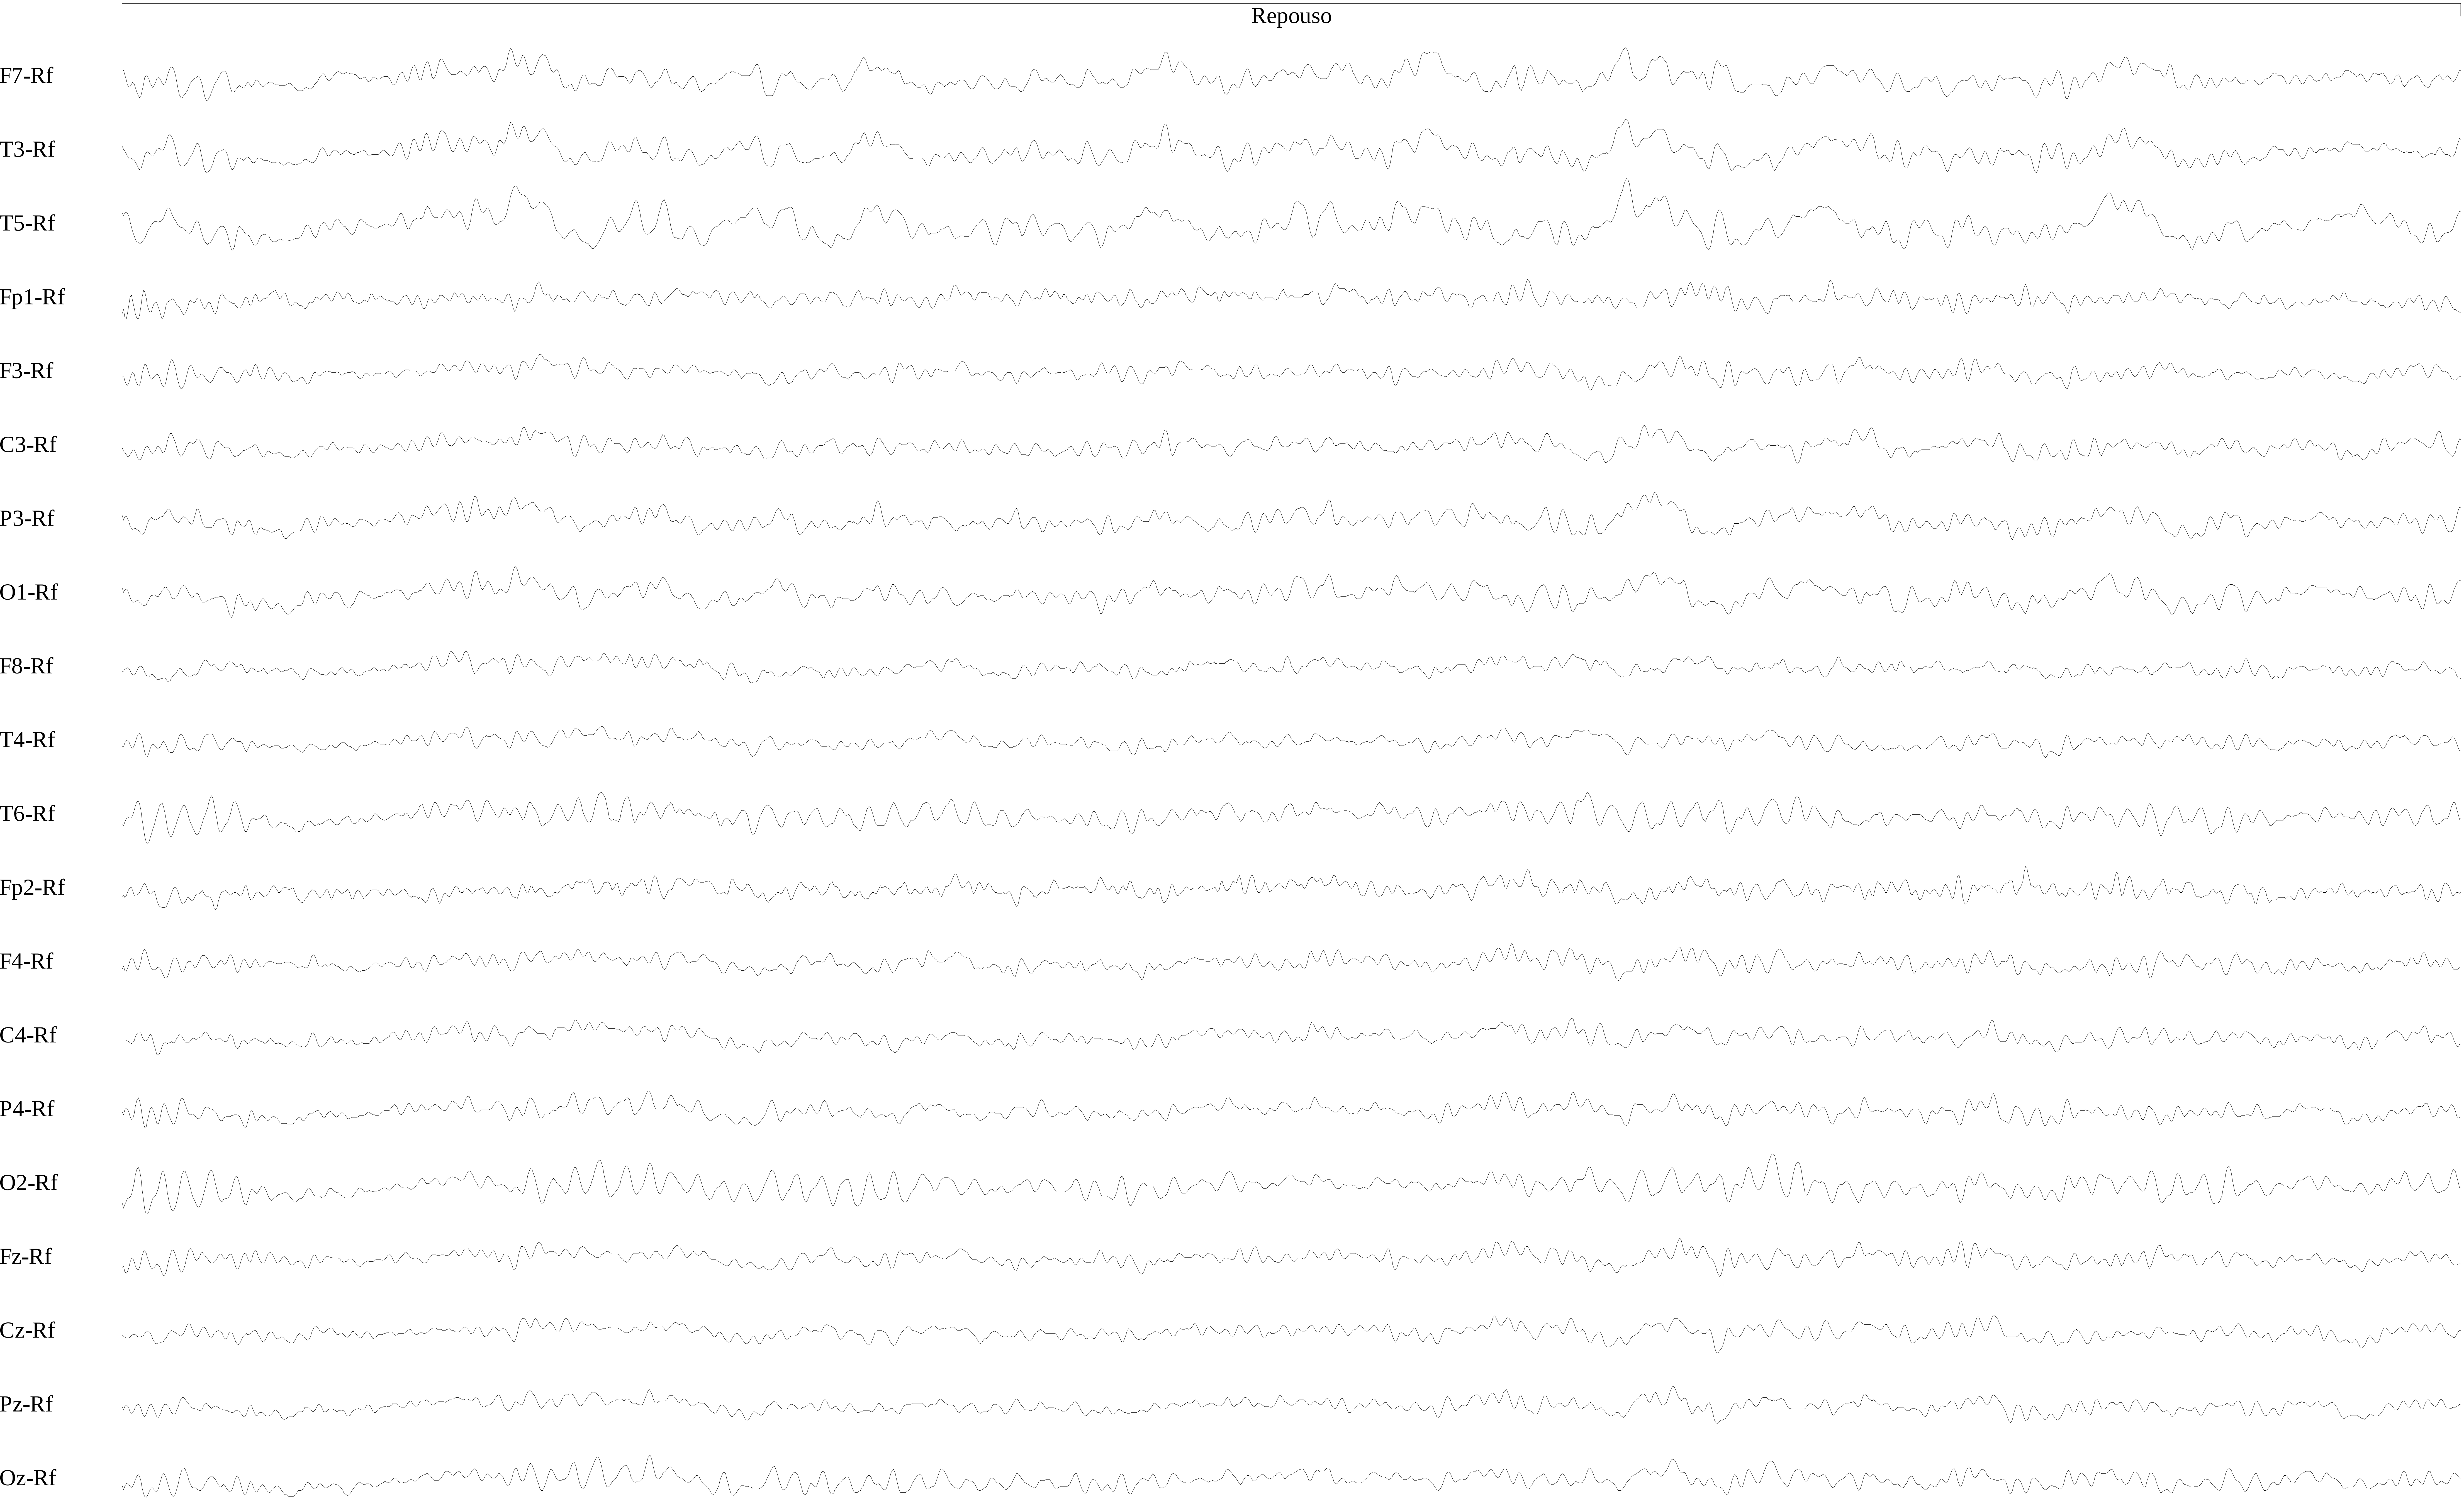


FOTO-Rf



FOTO-Rf

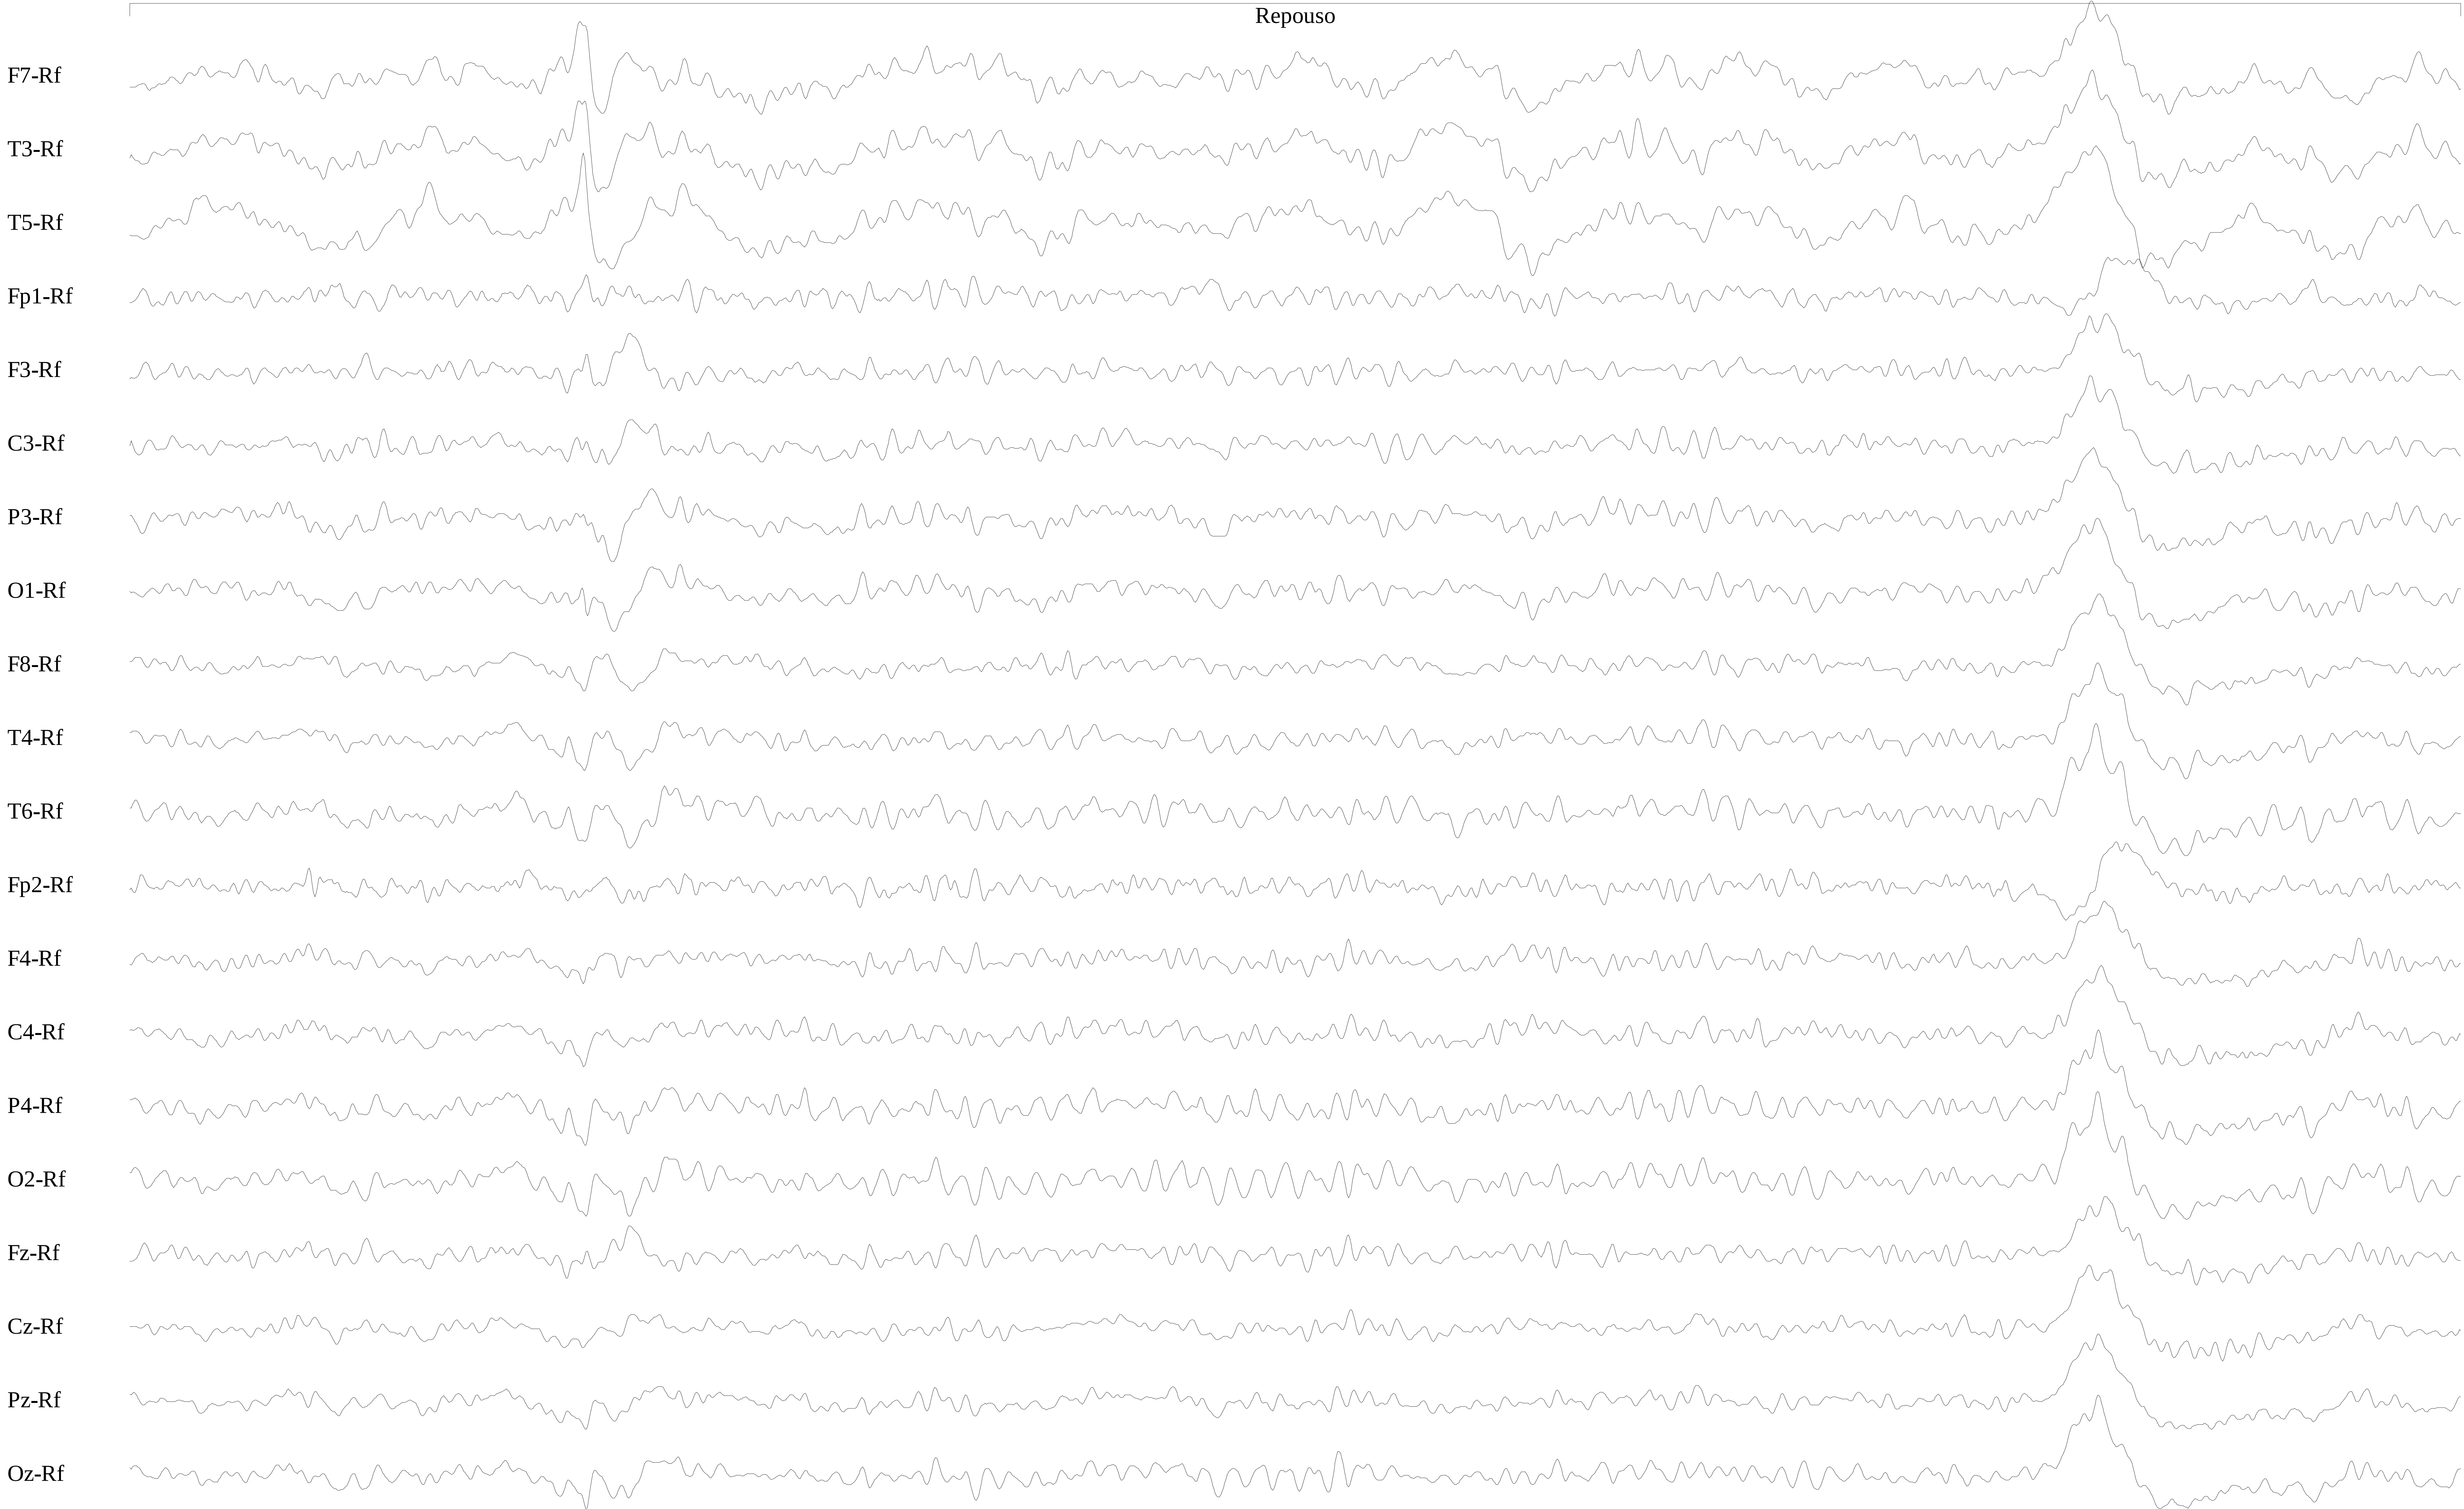


FOTO-Rf



FOTO-Rf

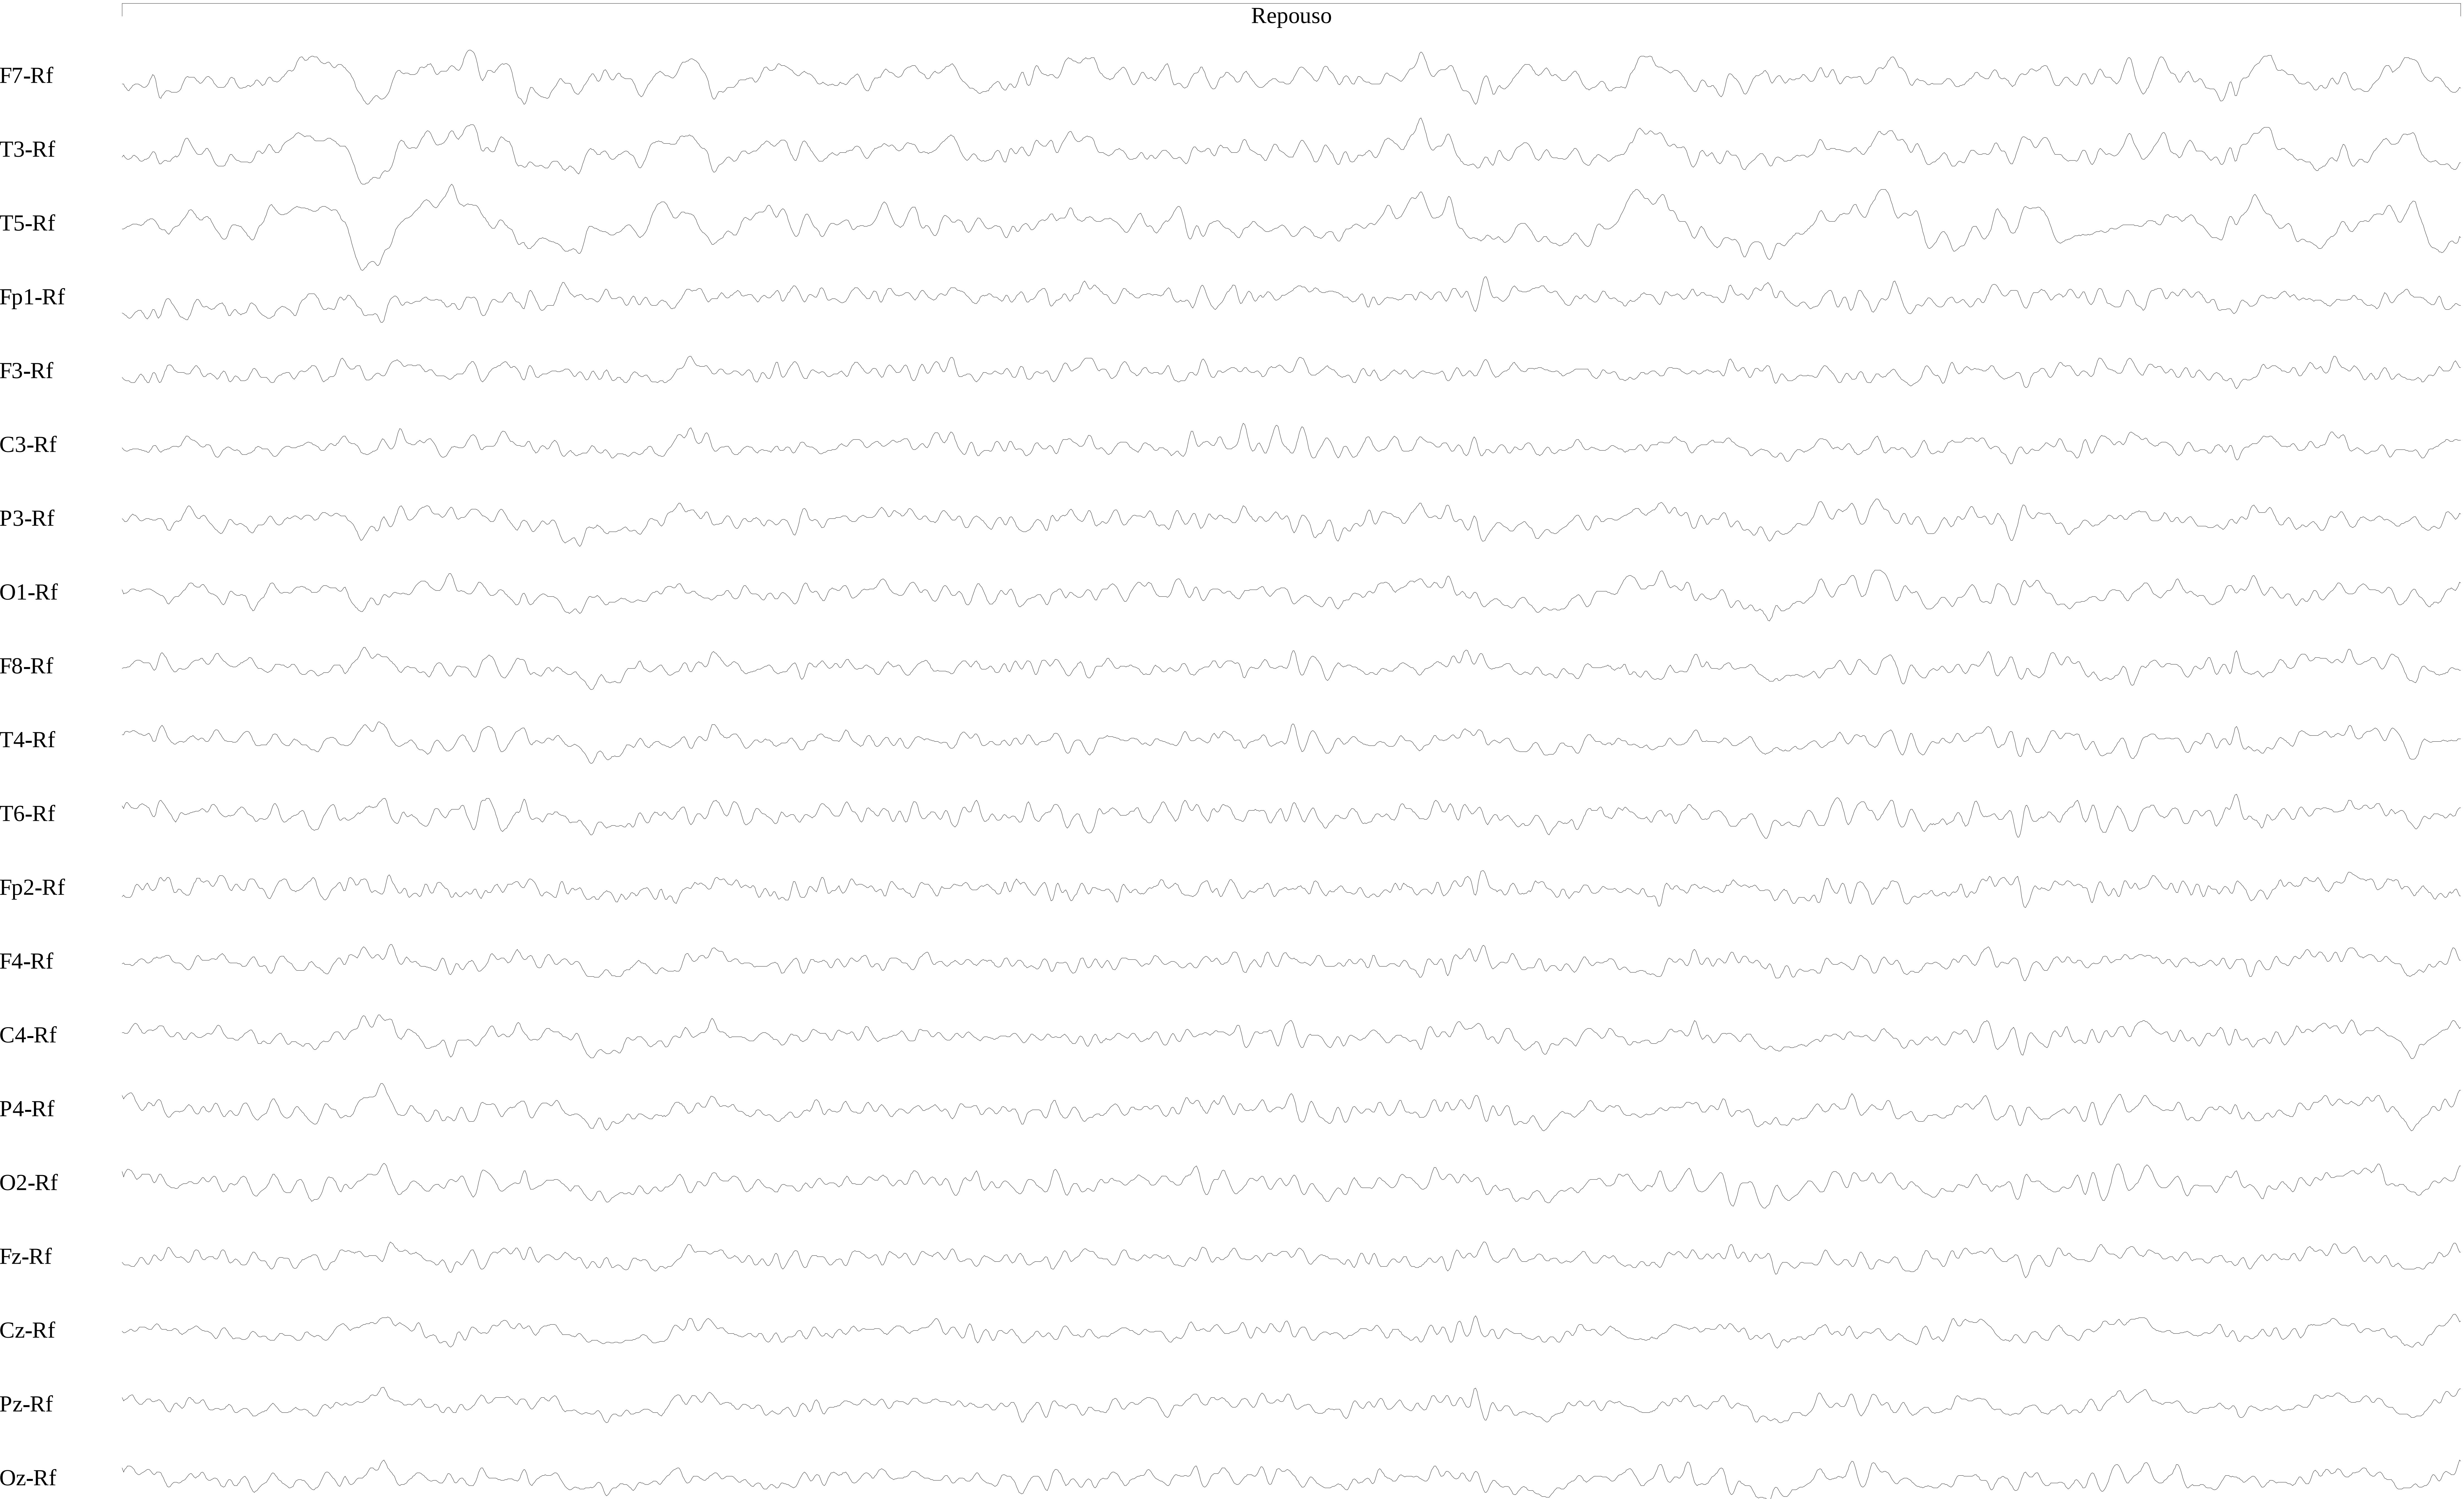


FOTO-Rf

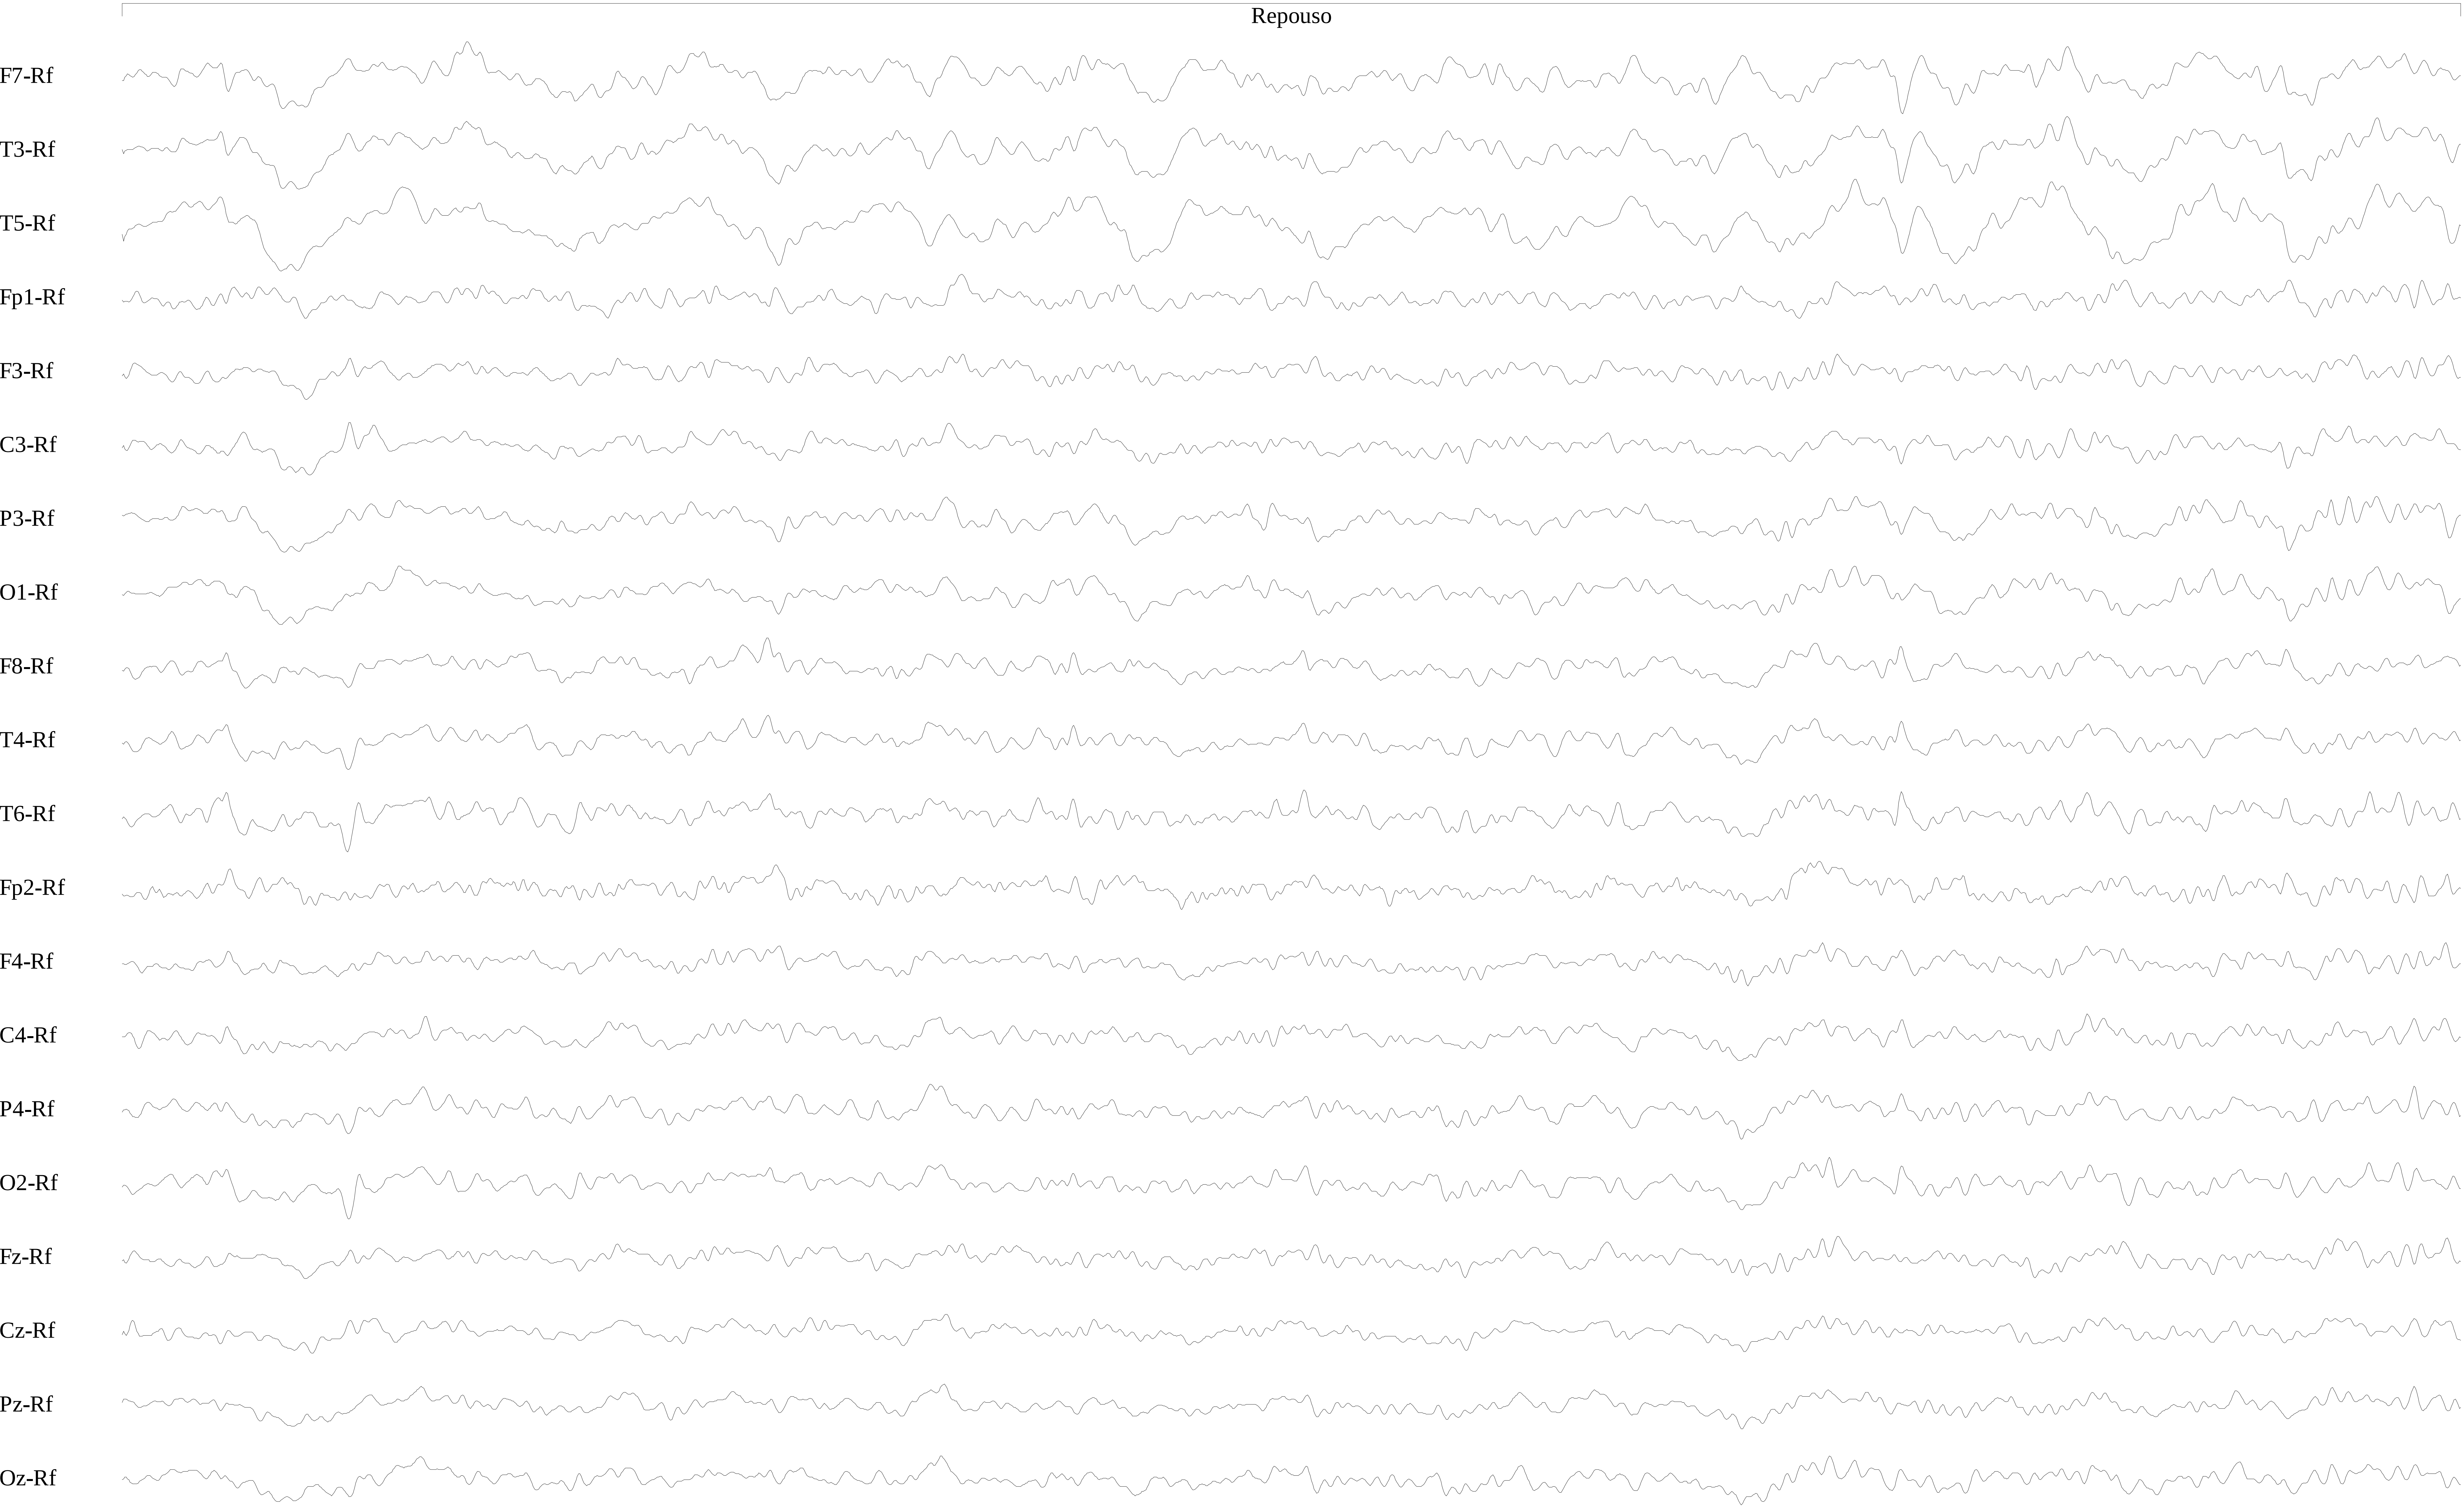


FOTO-Rf

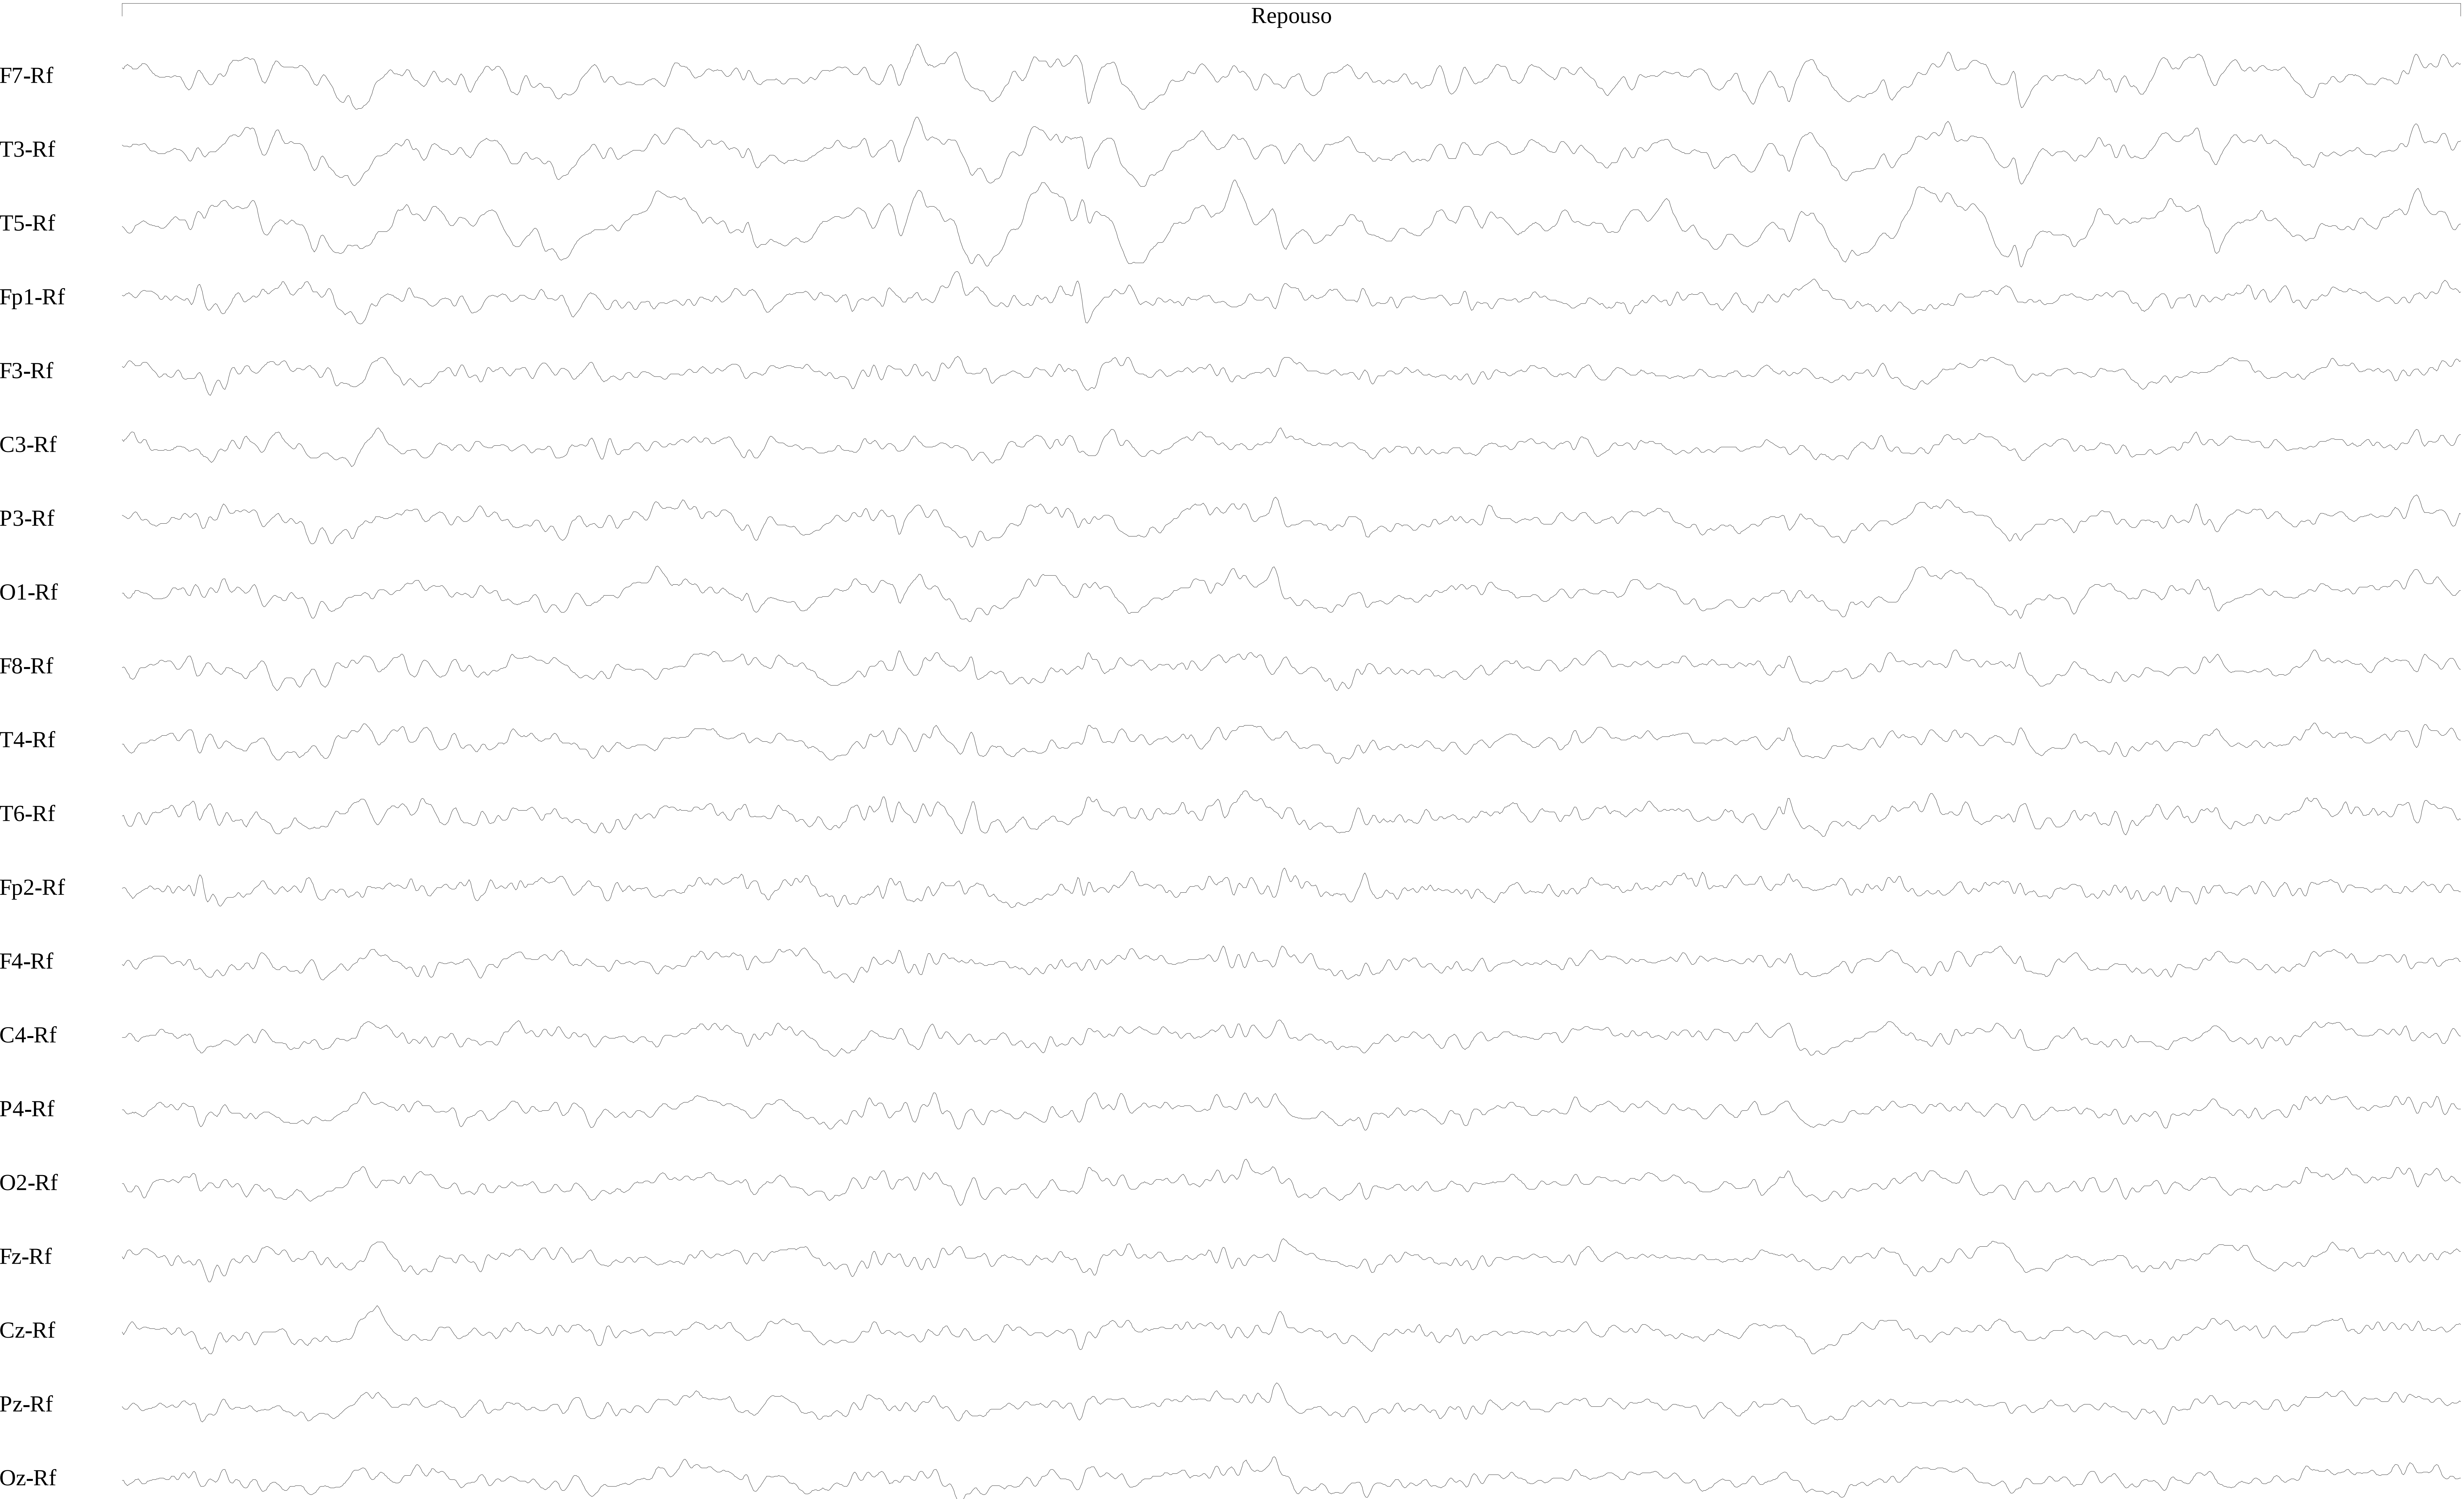


FOTO-Rf

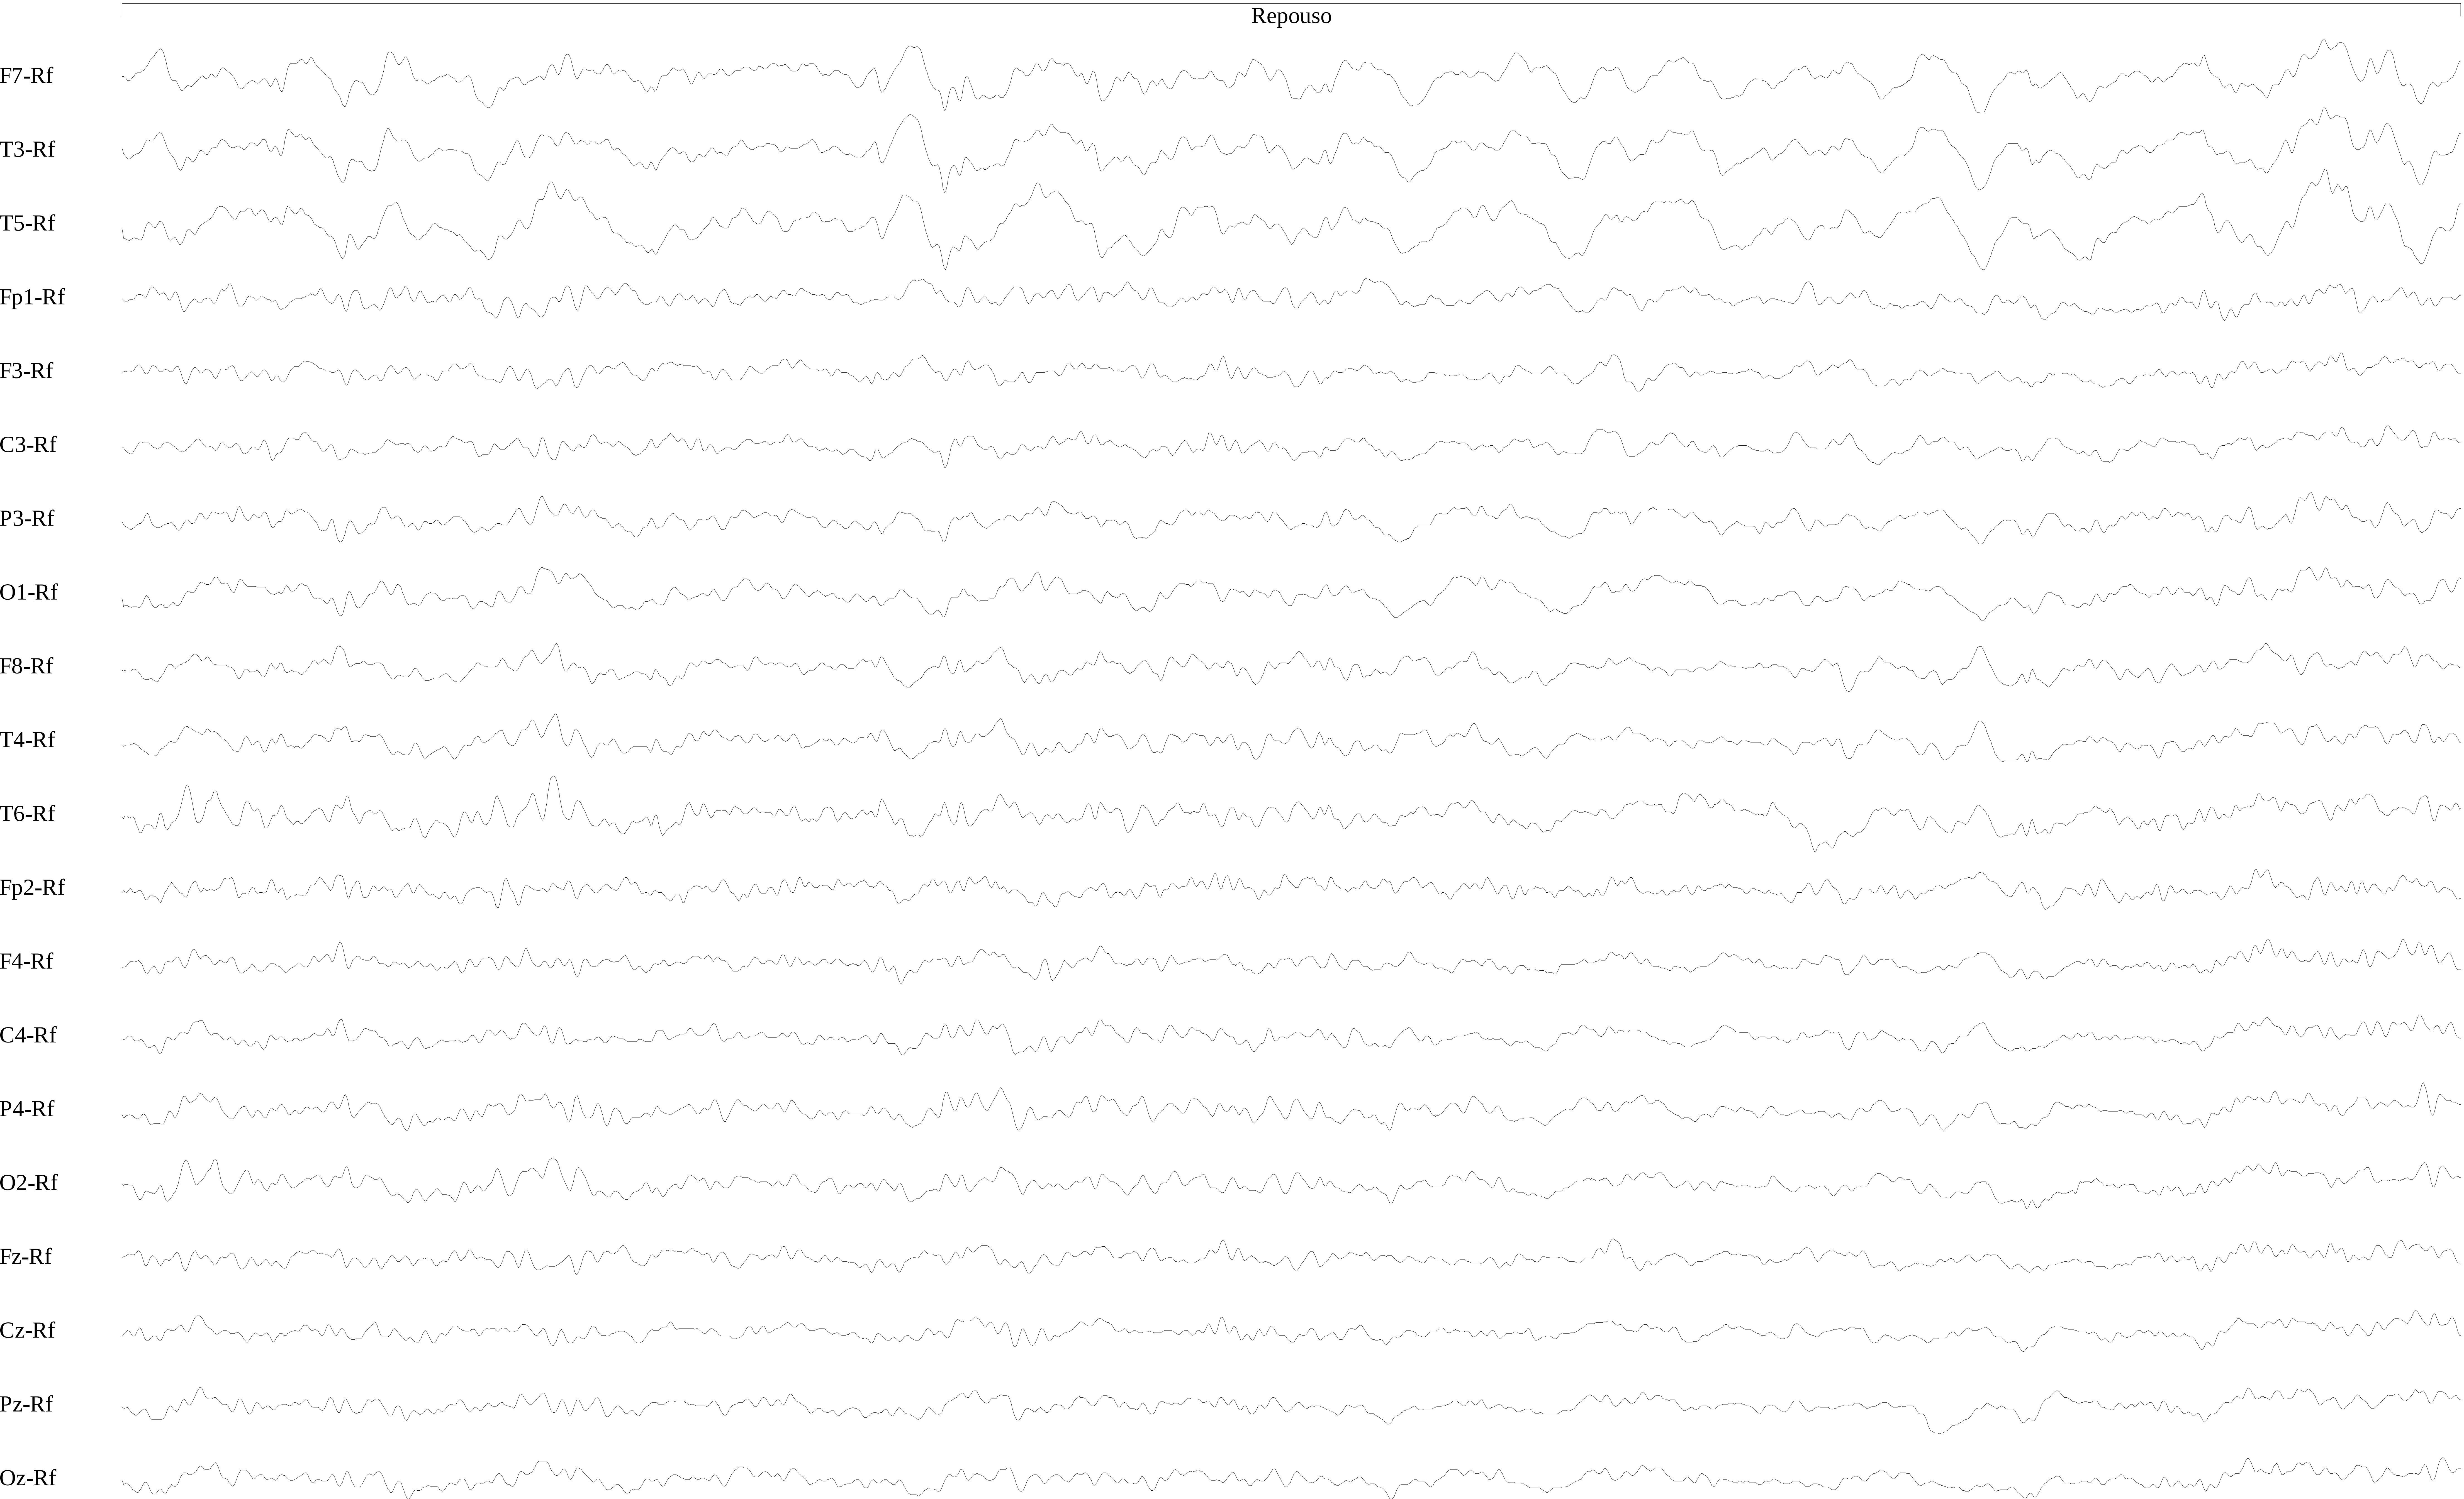


FOTO-Rf

[Aqui vai o nome do Medico/Clinica]

Olhos Abertos

F7-Rf
T3-Rf
T5-Rf
Fp1-Rf
F3-Rf
C3-Rf
P3-Rf
O1-Rf
F8-Rf
T4-Rf
T6-Rf
Fp2-Rf
F4-Rf
C4-Rf
P4-Rf
O2-Rf
Fz-Rf
Cz-Rf
Pz-Rf
Oz-Rf

FOTO-Rf

100µV

00:05:51,0

Montagem: Padrão; Velocidade : 30,00mm/s; Amplitude - EEG: 100,00µV/cm

DEUSNY JOSE DE FREITAS (66 a e 8 m - M), Ex: 12389-01 (17/07/2025)

00:05:59,765

Olhos Abertos

F7-Rf
T3-Rf
T5-Rf
Fp1-Rf
F3-Rf
C3-Rf
P3-Rf
O1-Rf
F8-Rf
T4-Rf
T6-Rf
Fp2-Rf
F4-Rf
C4-Rf
P4-Rf
O2-Rf
Fz-Rf
Cz-Rf
Pz-Rf
Oz-Rf

FOTO-Rf

100µV


00:06:12,0

Montagem: Padrão; Velocidade : 30,00mm/s; Amplitude - EEG: 100,00µV/cm

DEUSNY JOSE DE FREITAS (66 a e 8 m - M), Ex: 12389-01 (17/07/2025)

00:06:20,765

[Aqui vai o nome do Medico/Clinica]

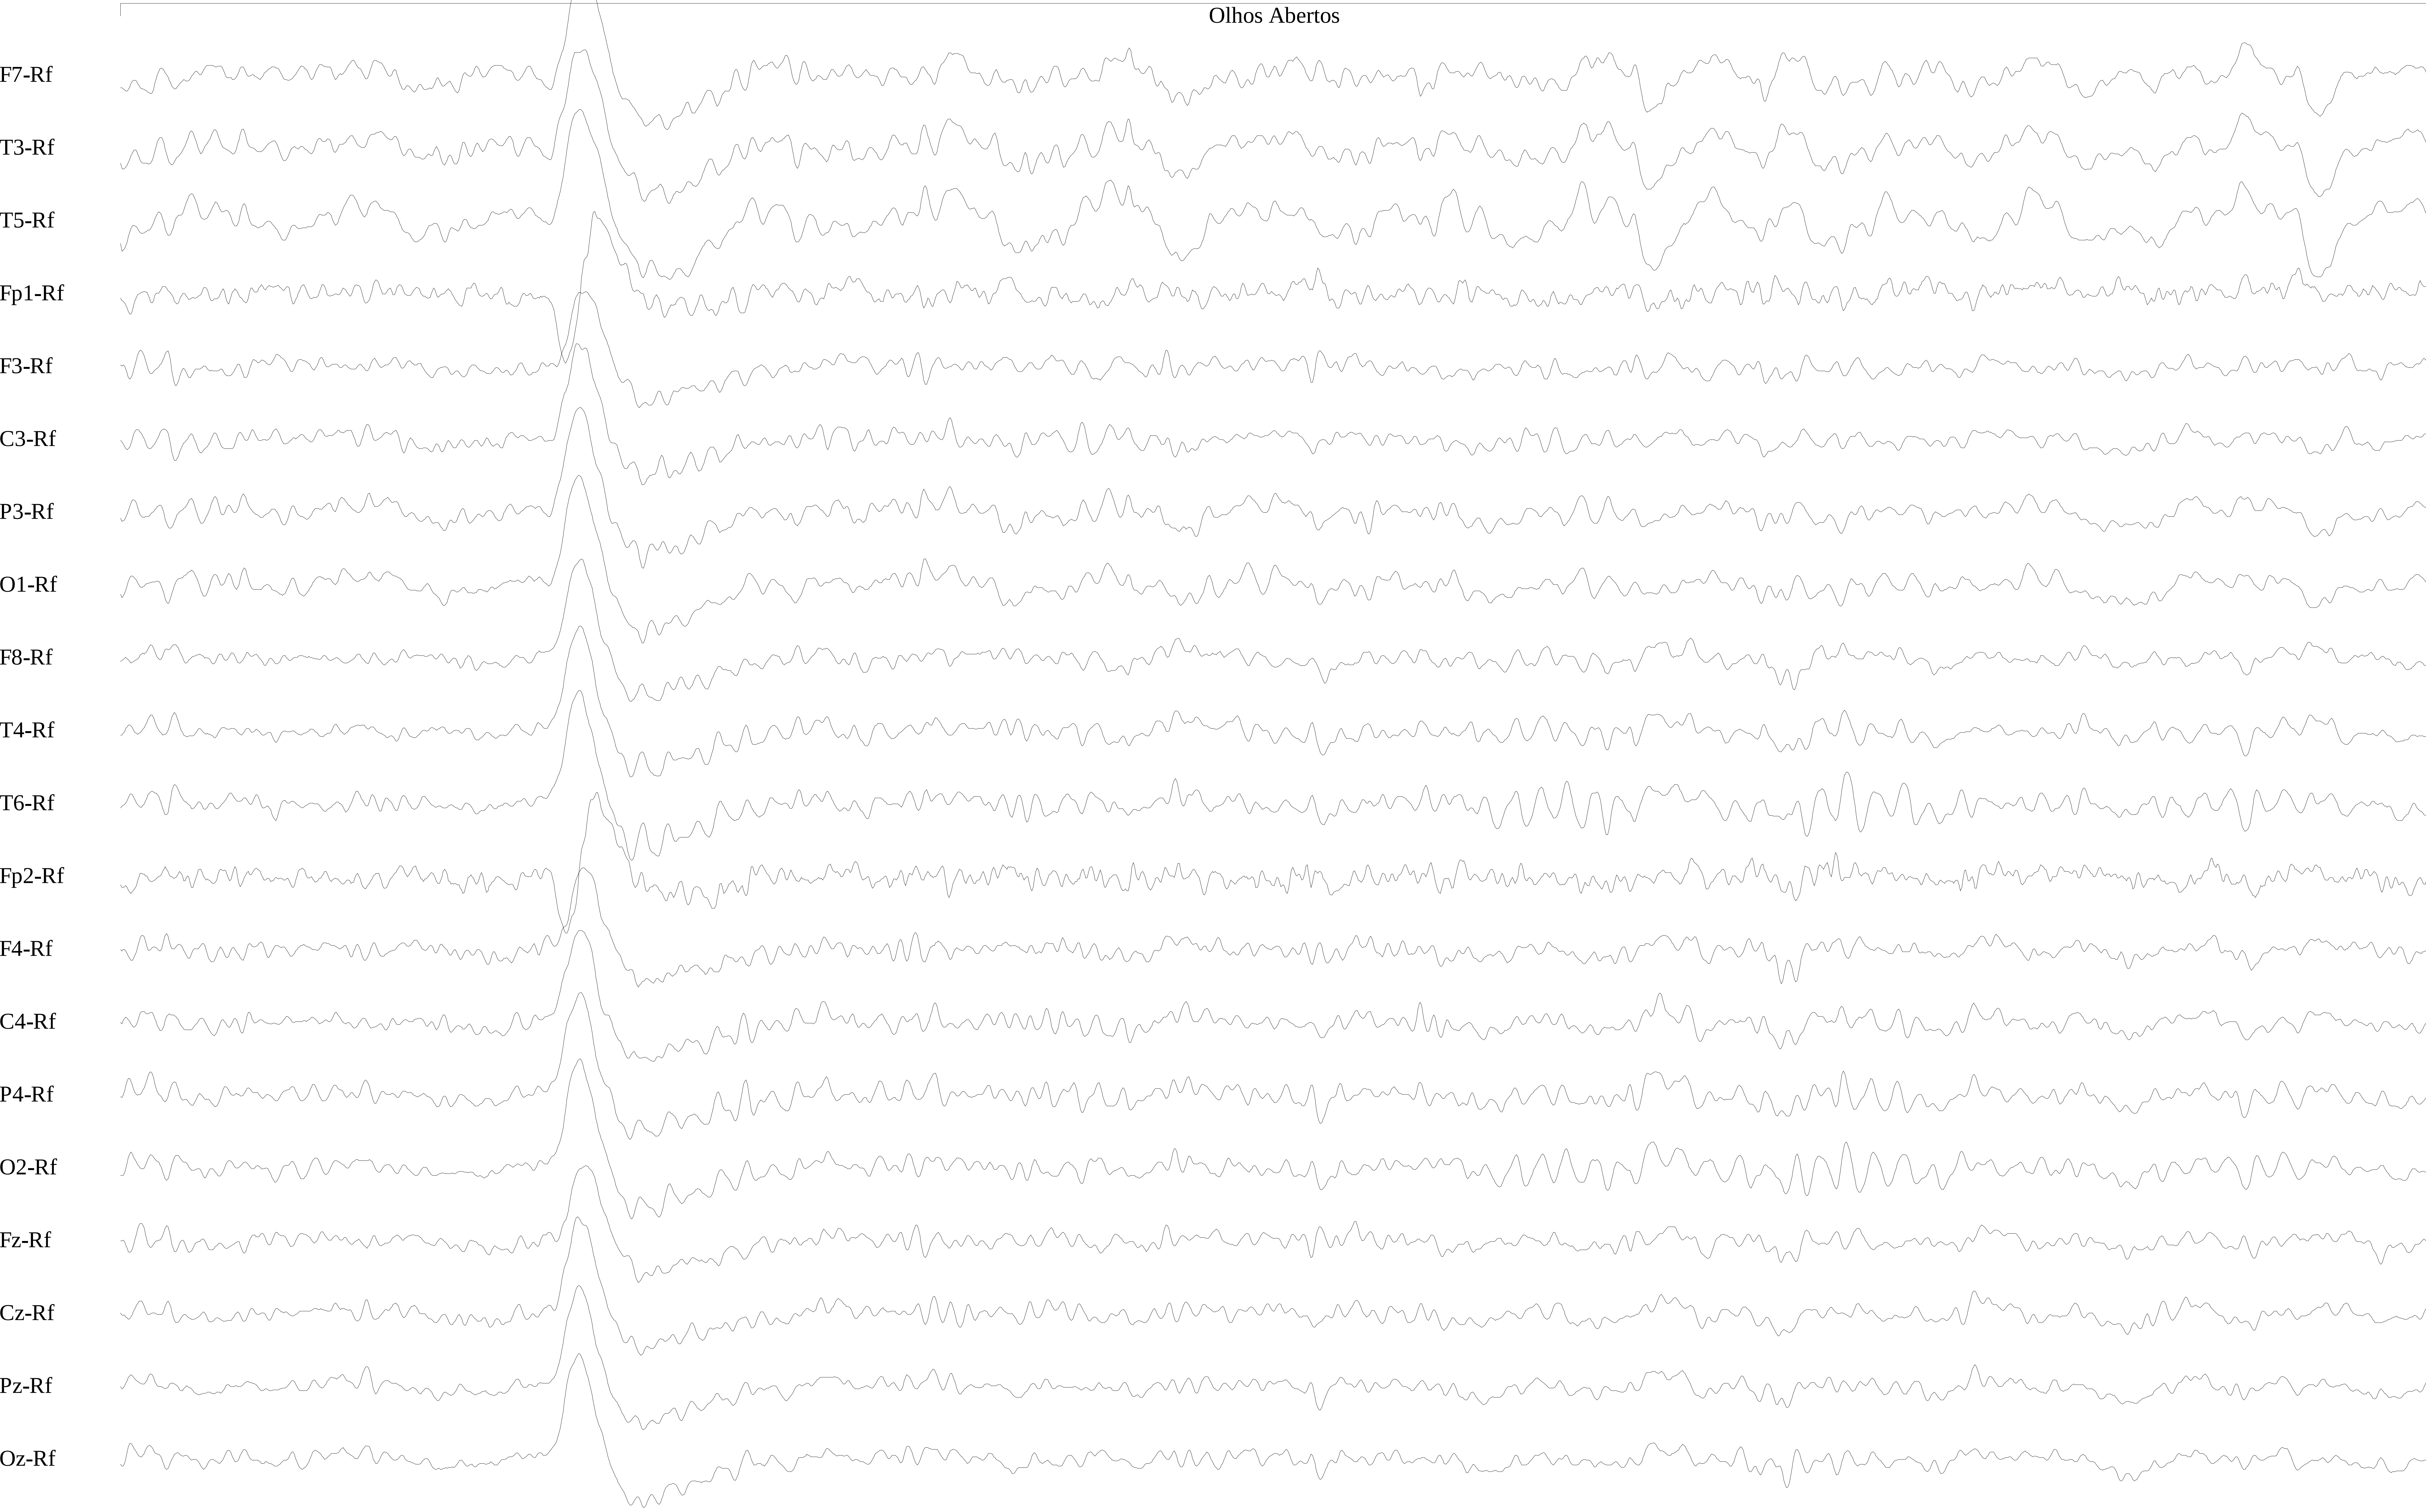

[Aqui vai o nome do Medico/Clinica]

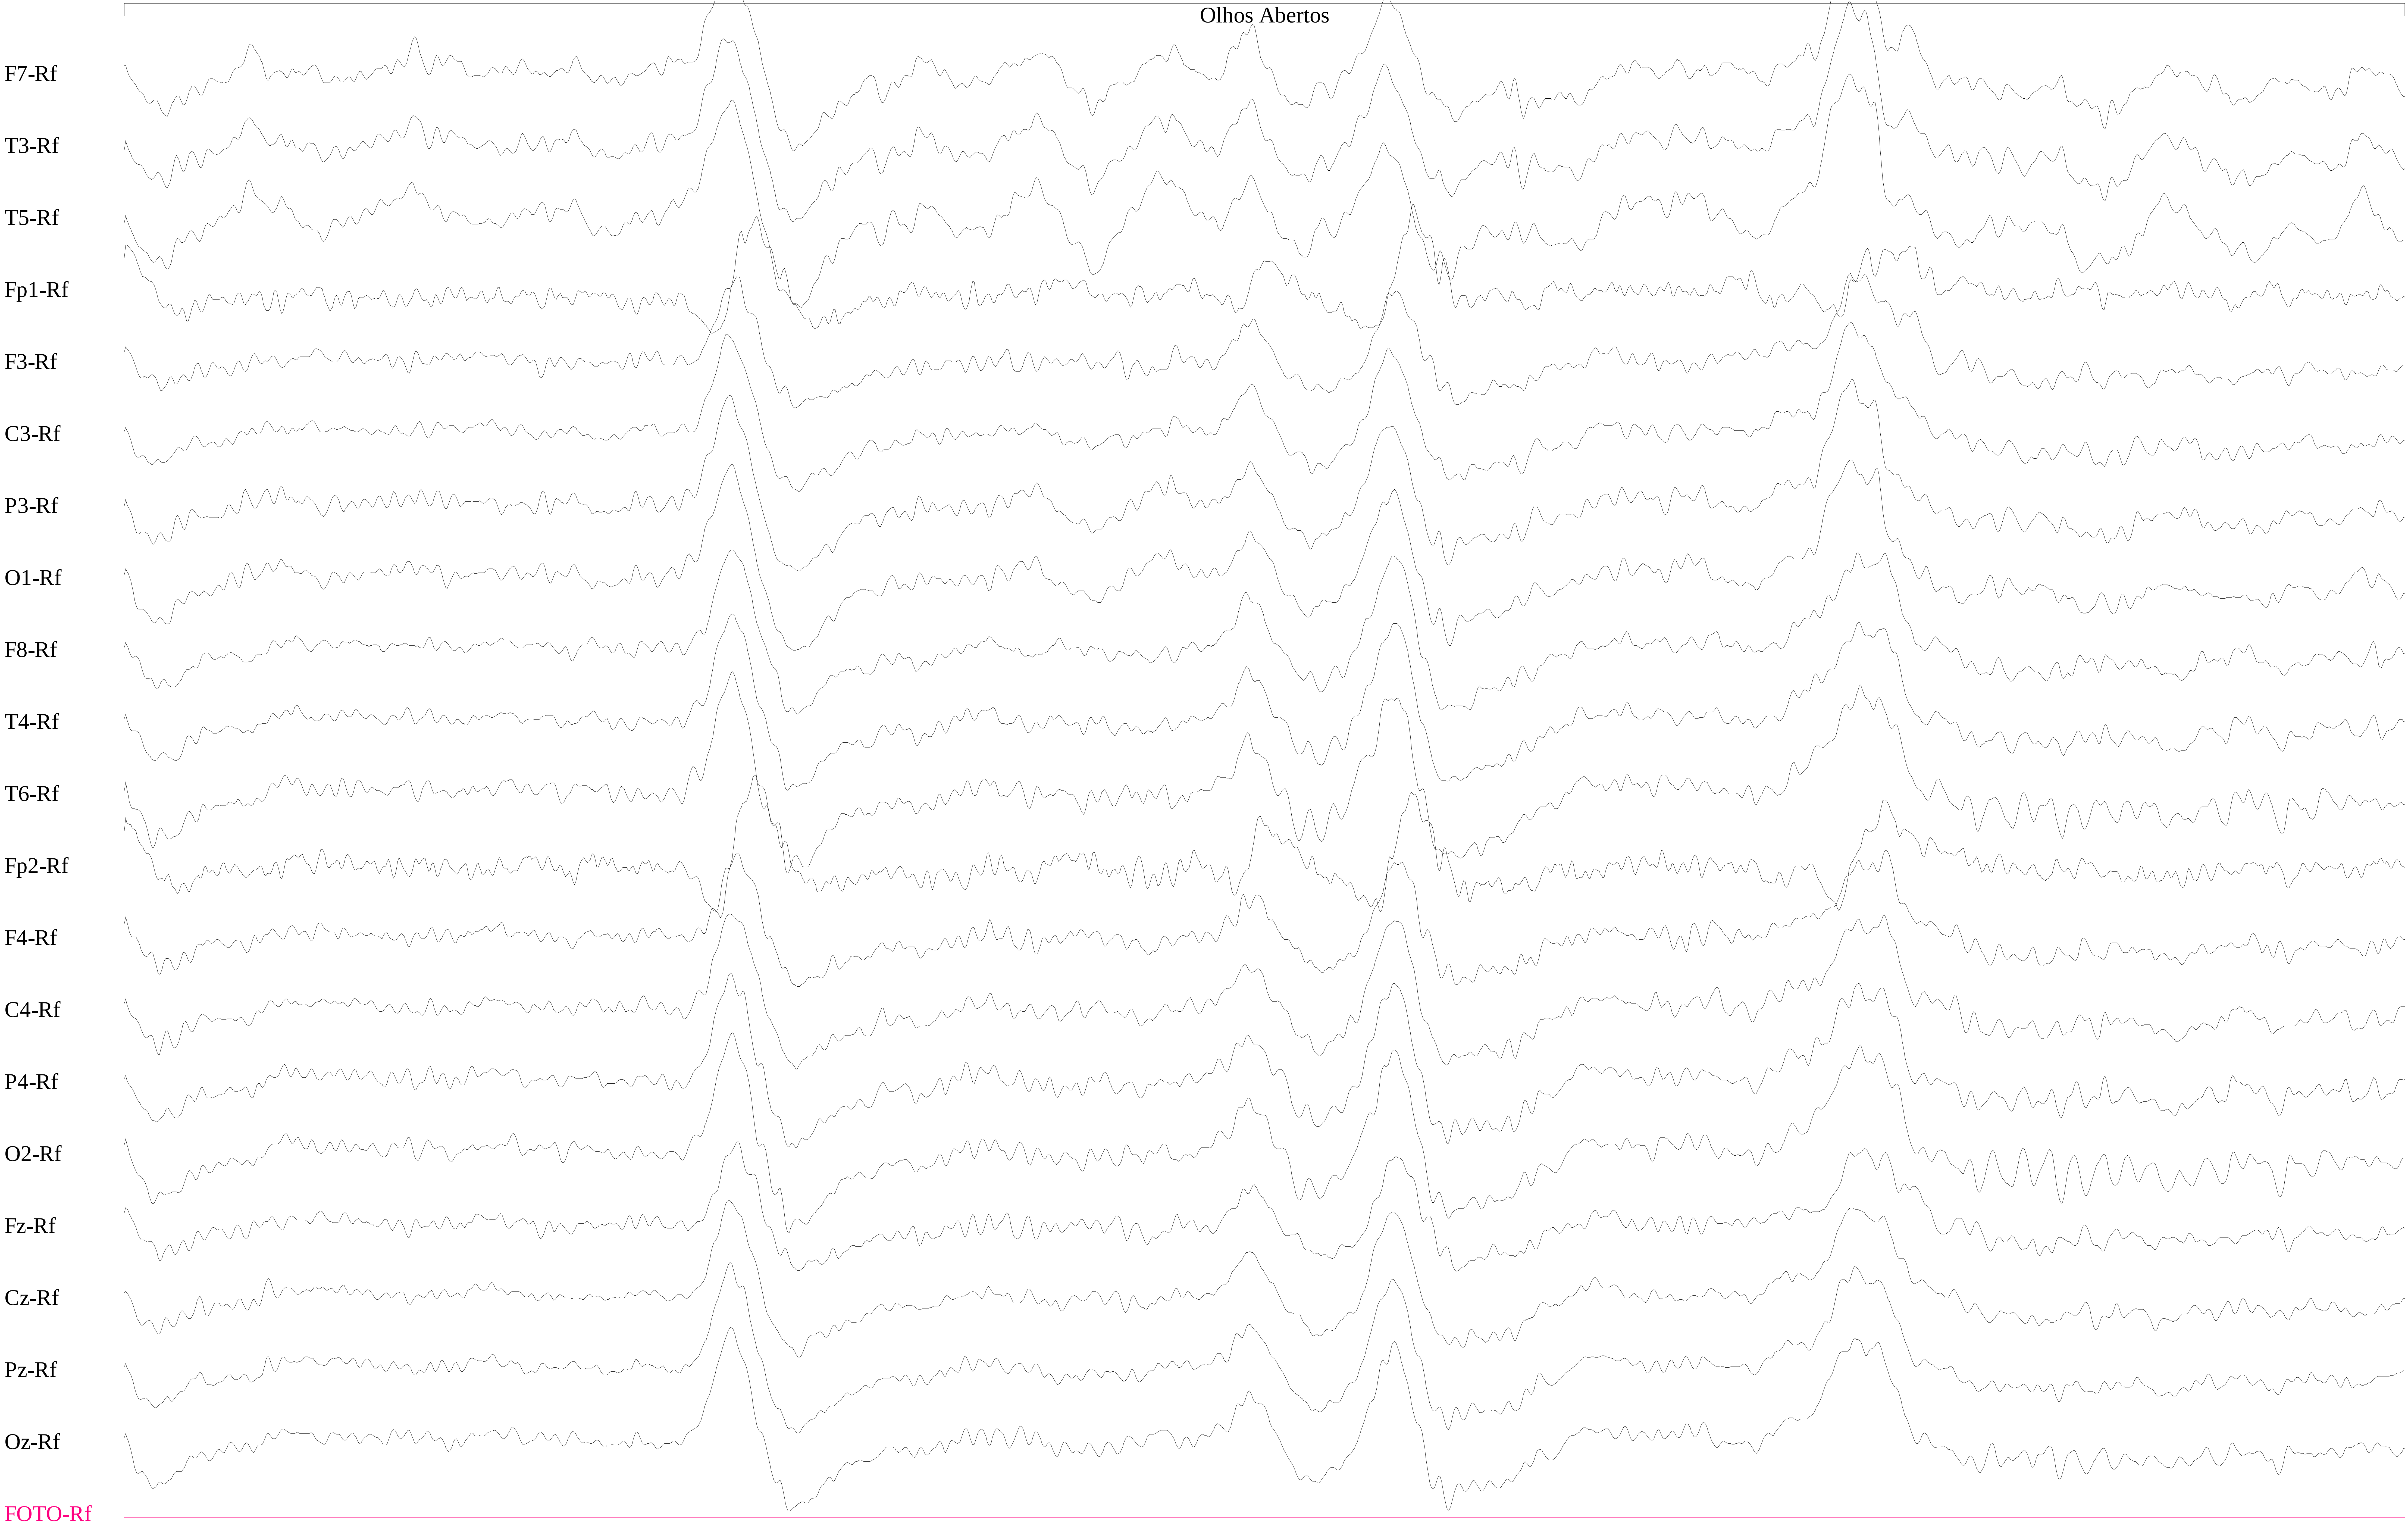
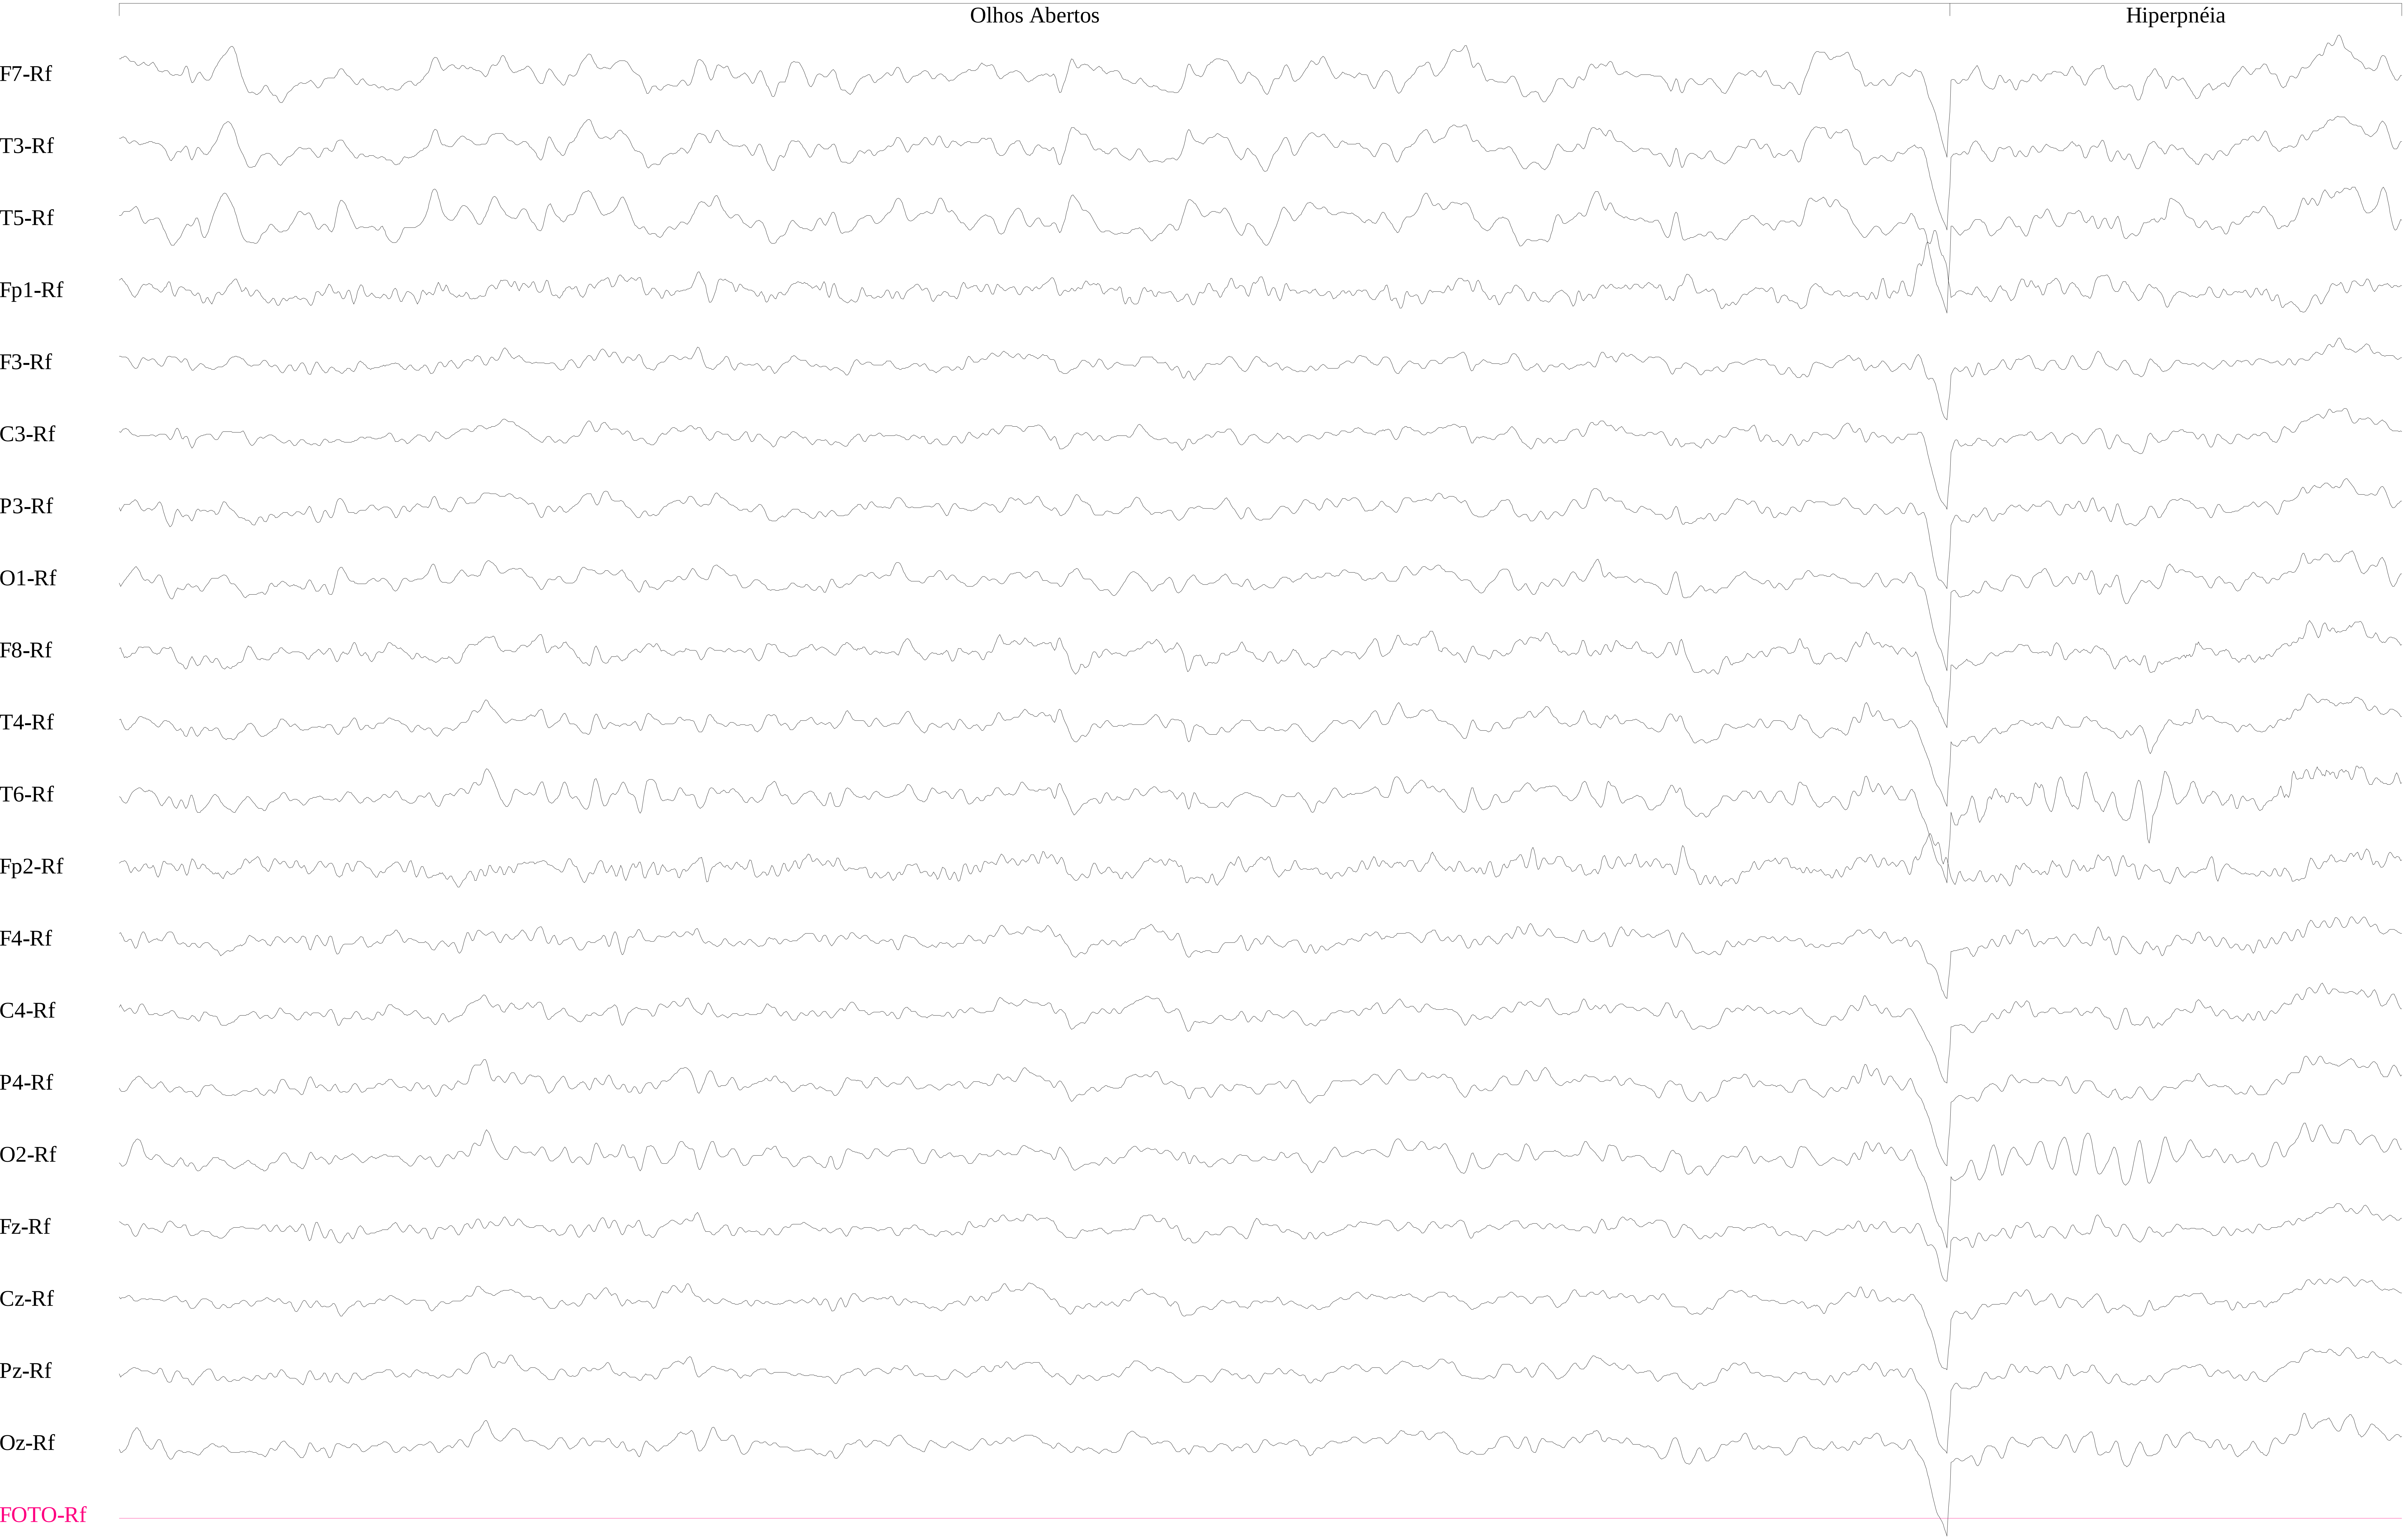


FOTO-Rf



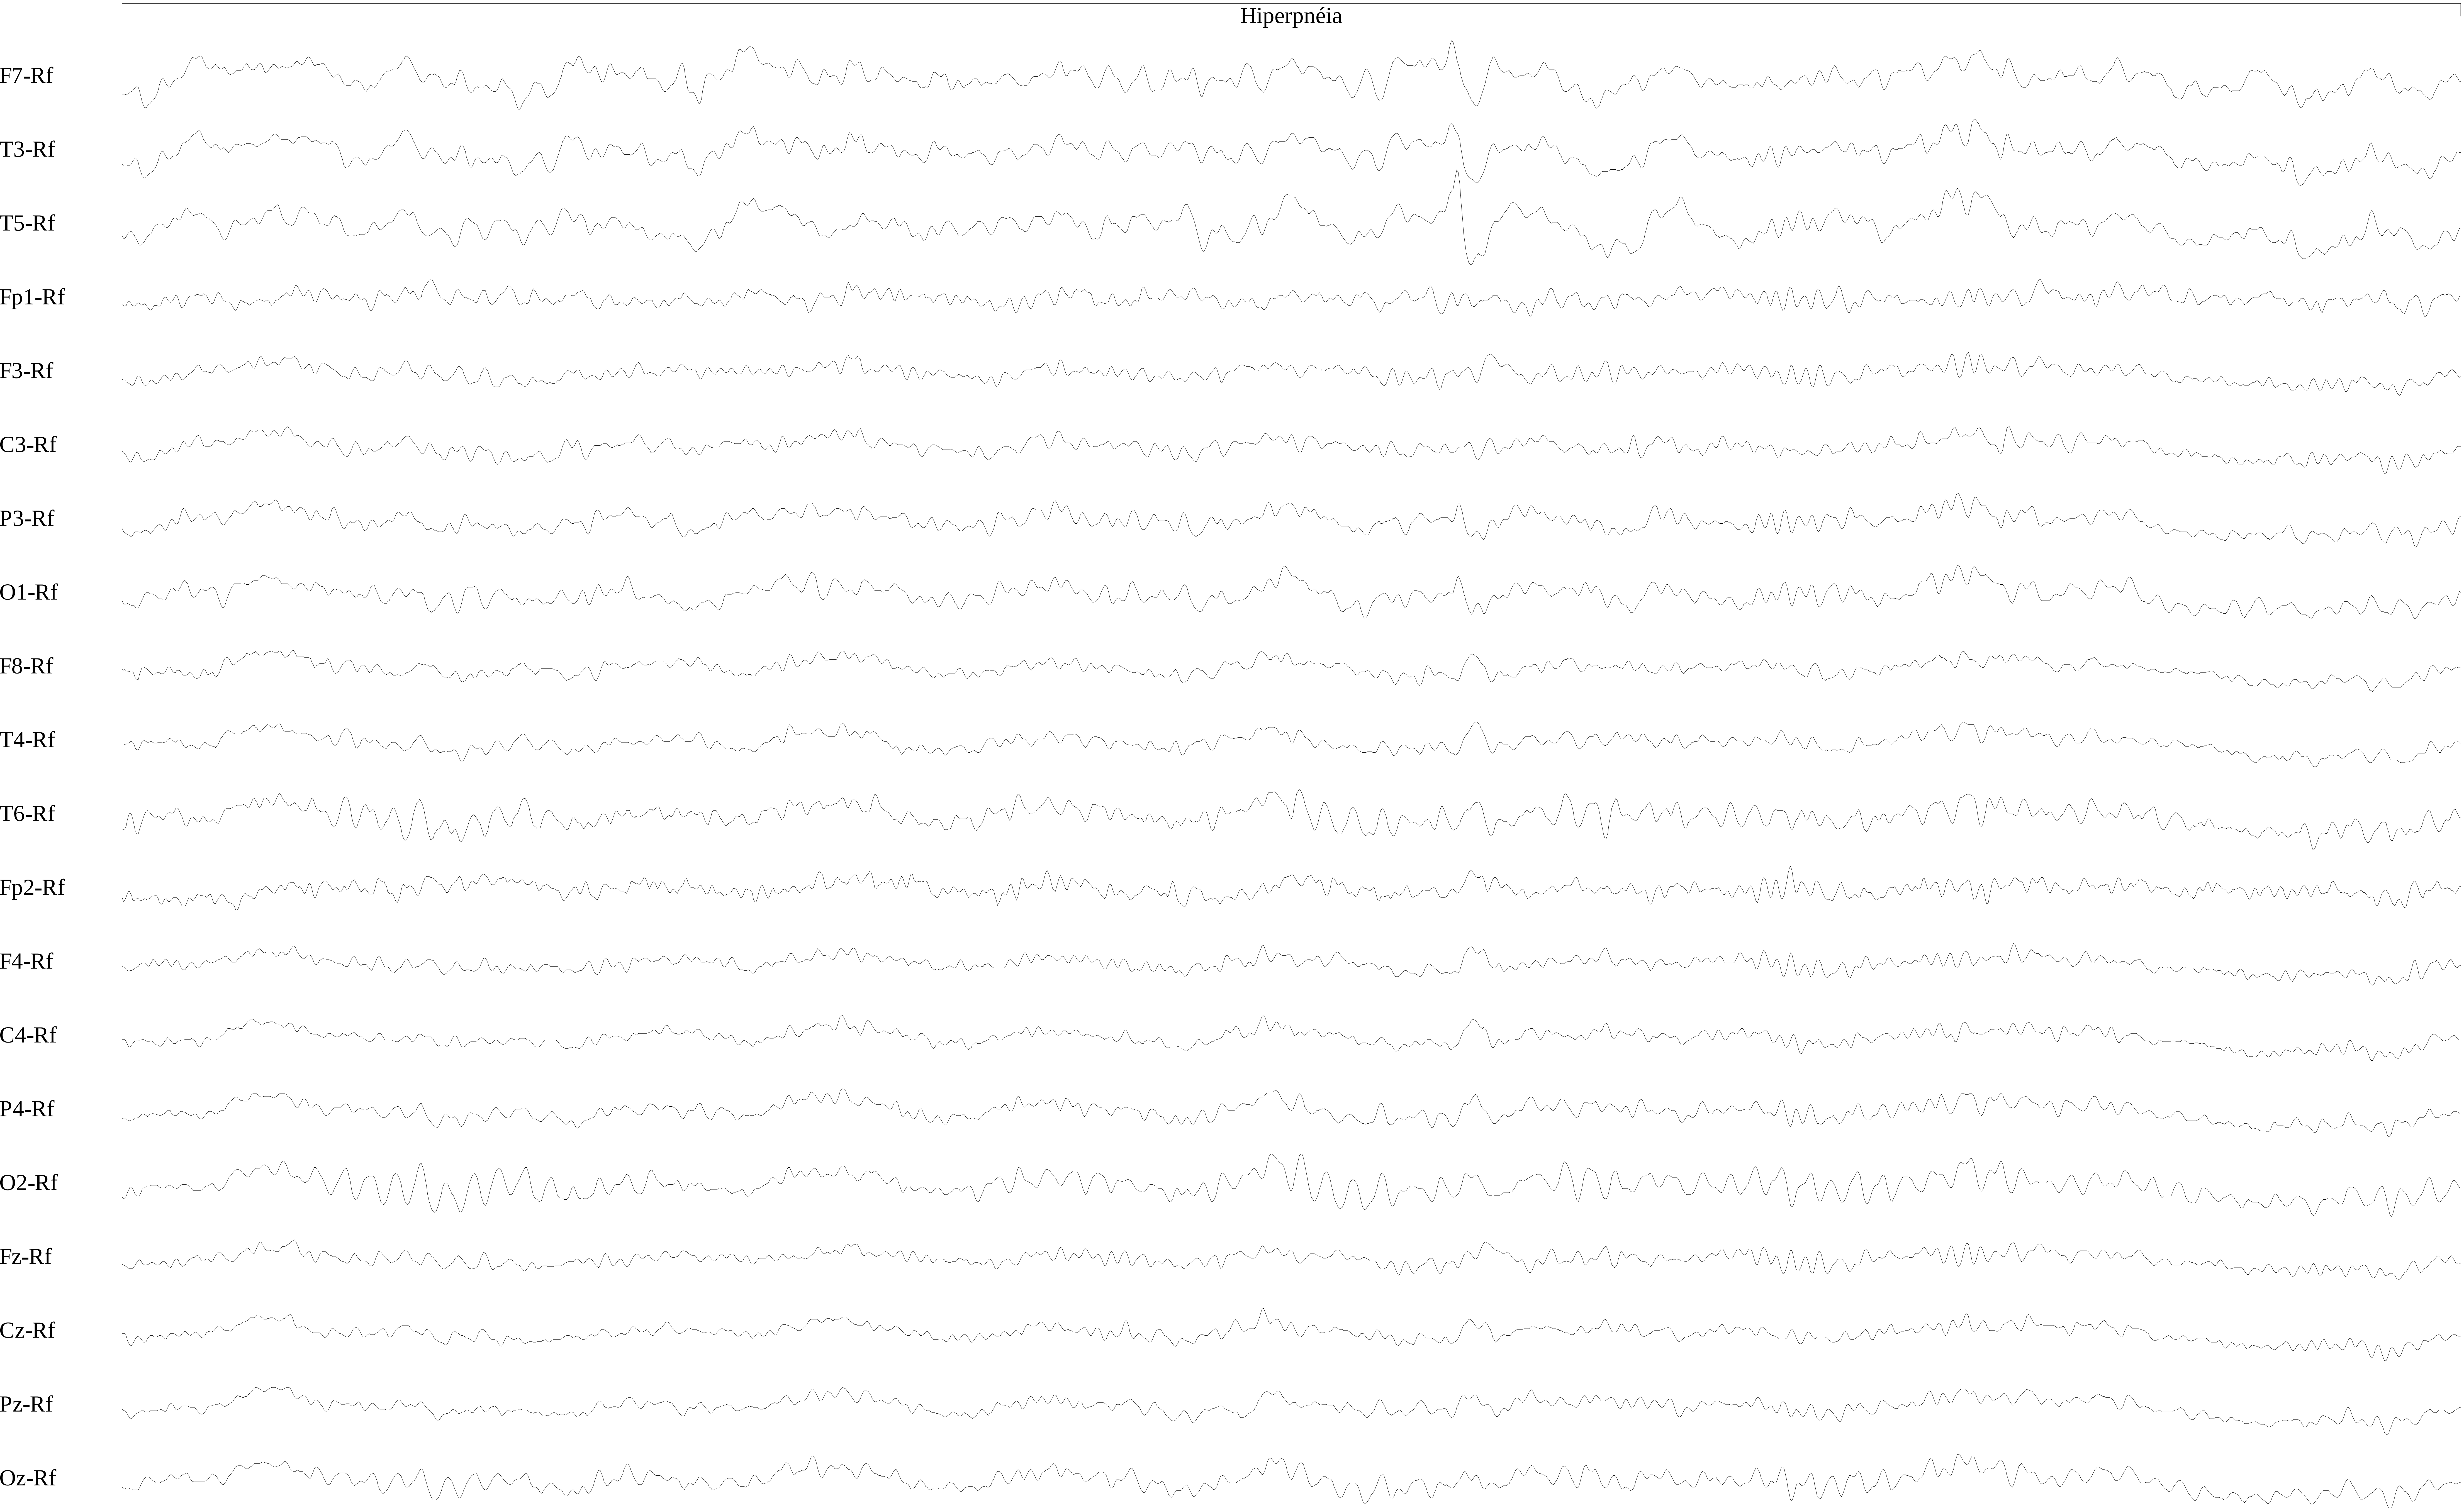


FOTO-Rf





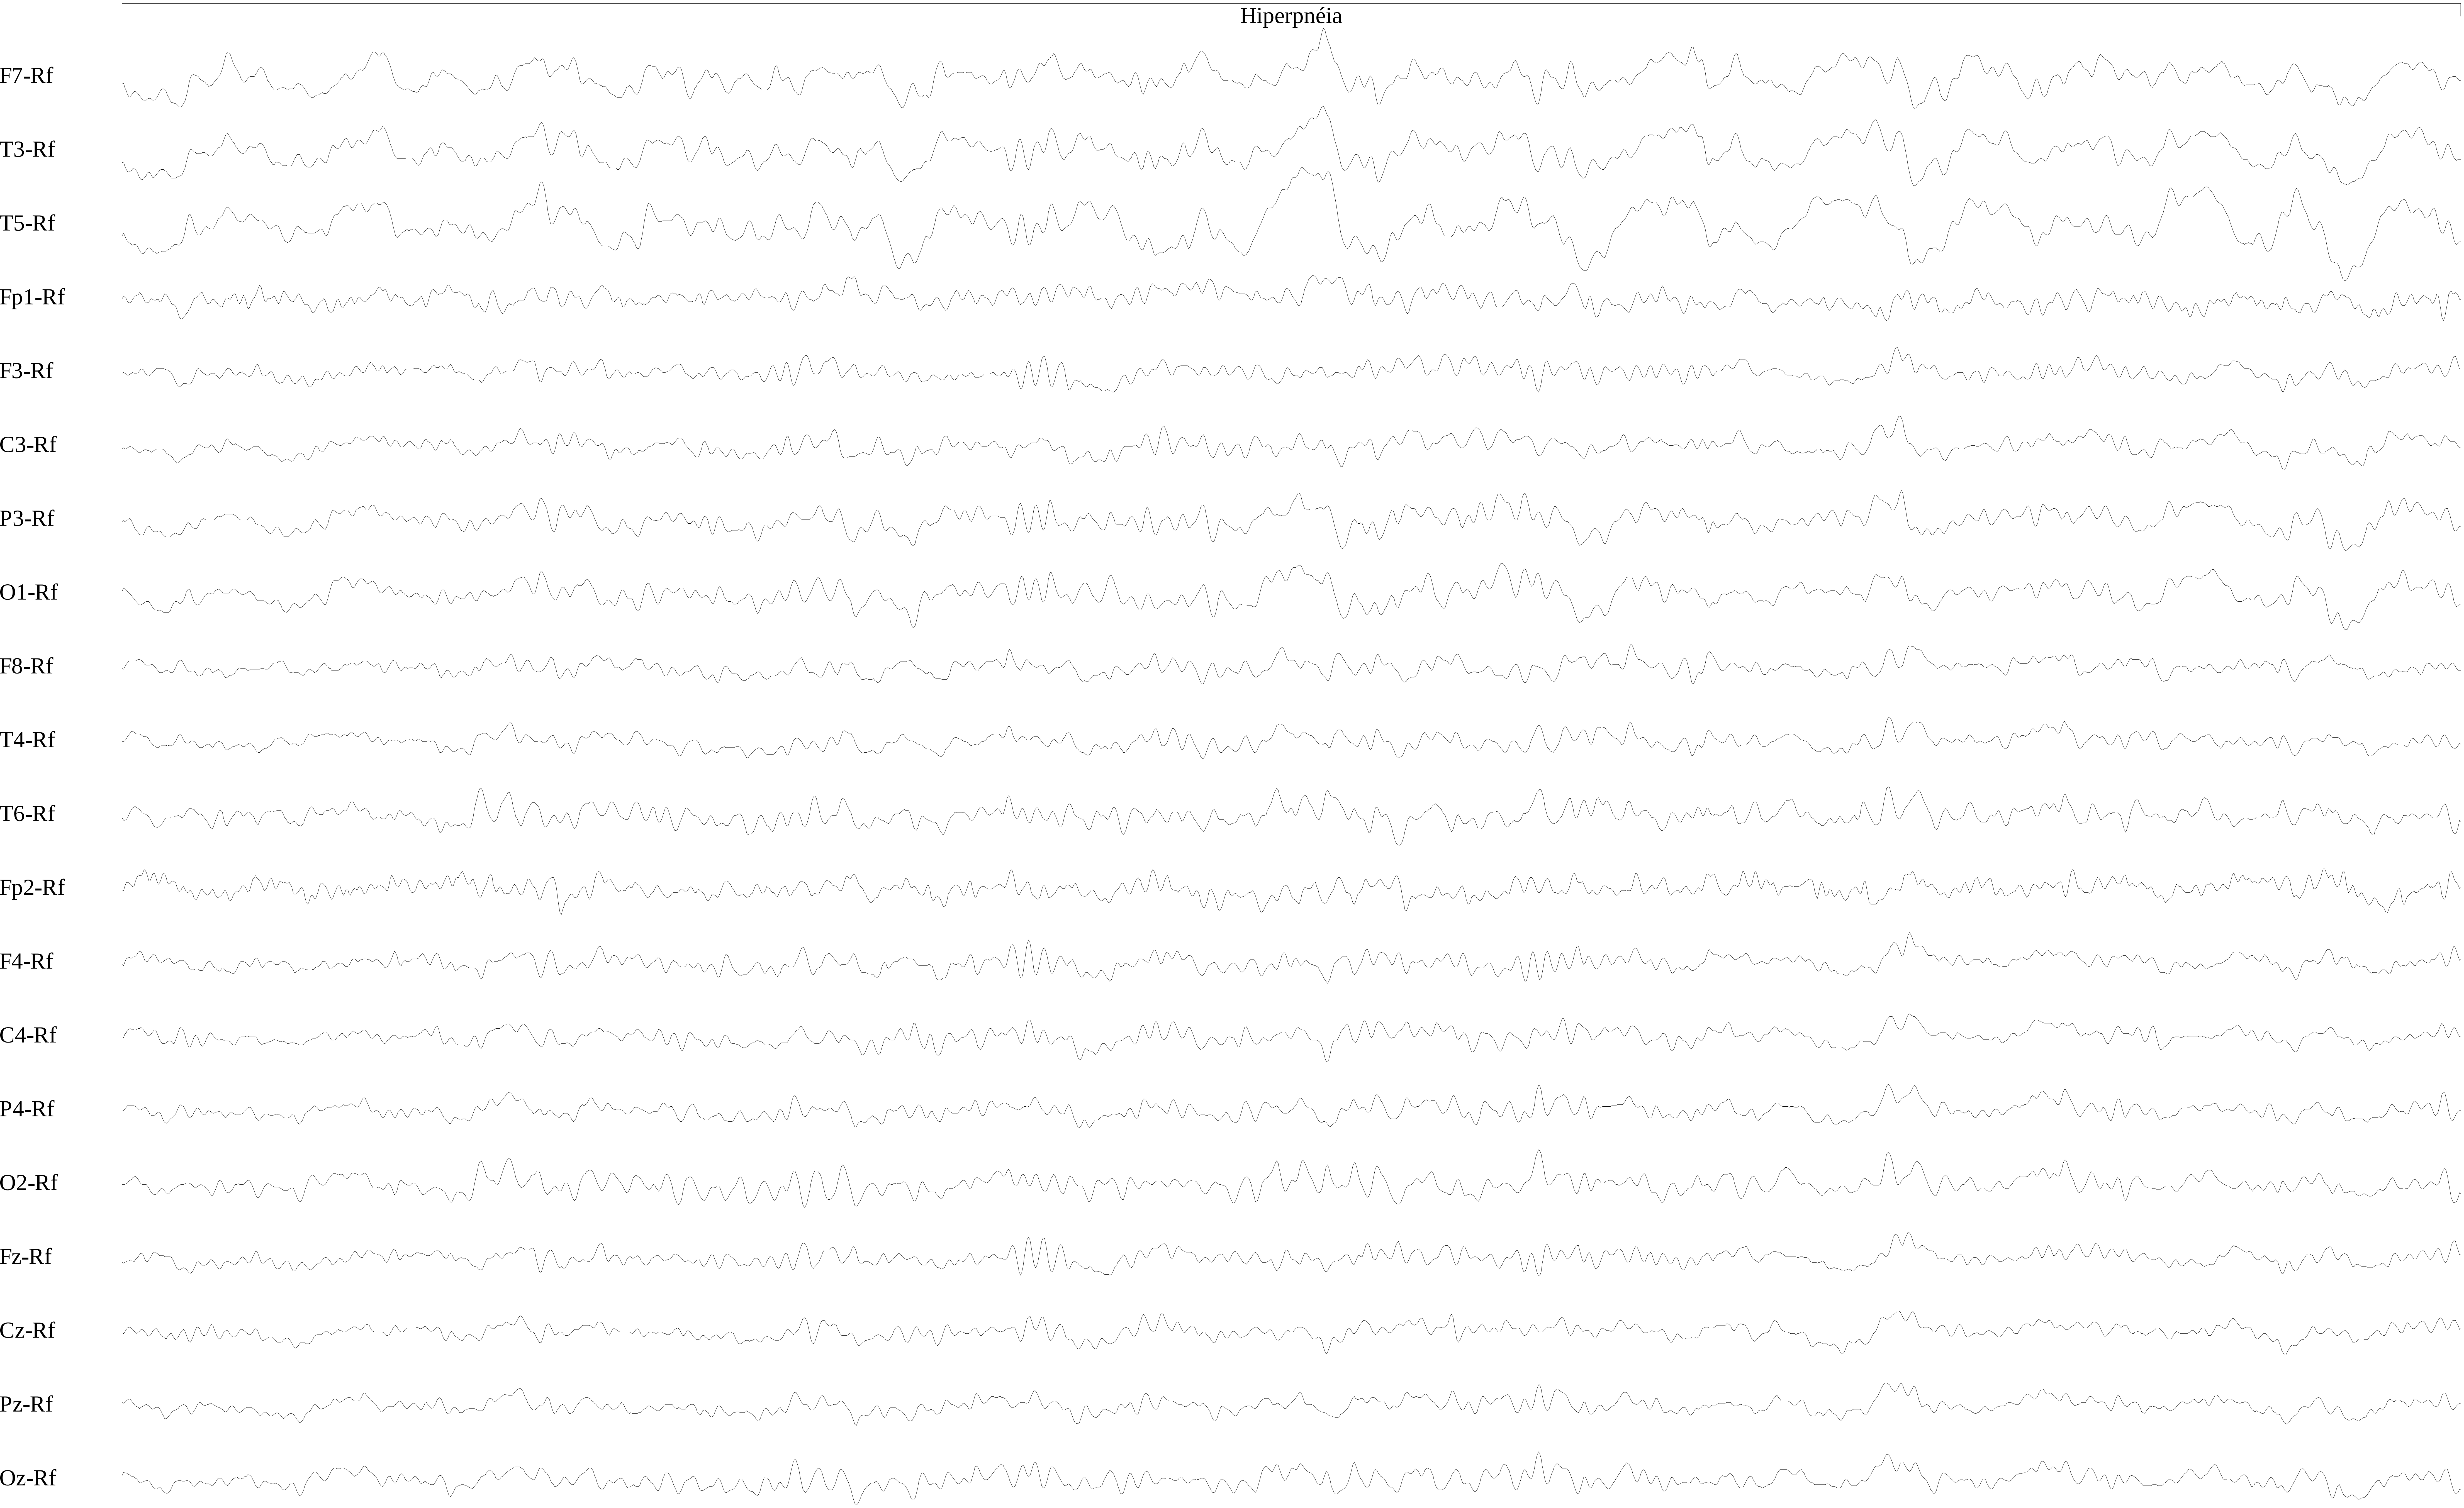
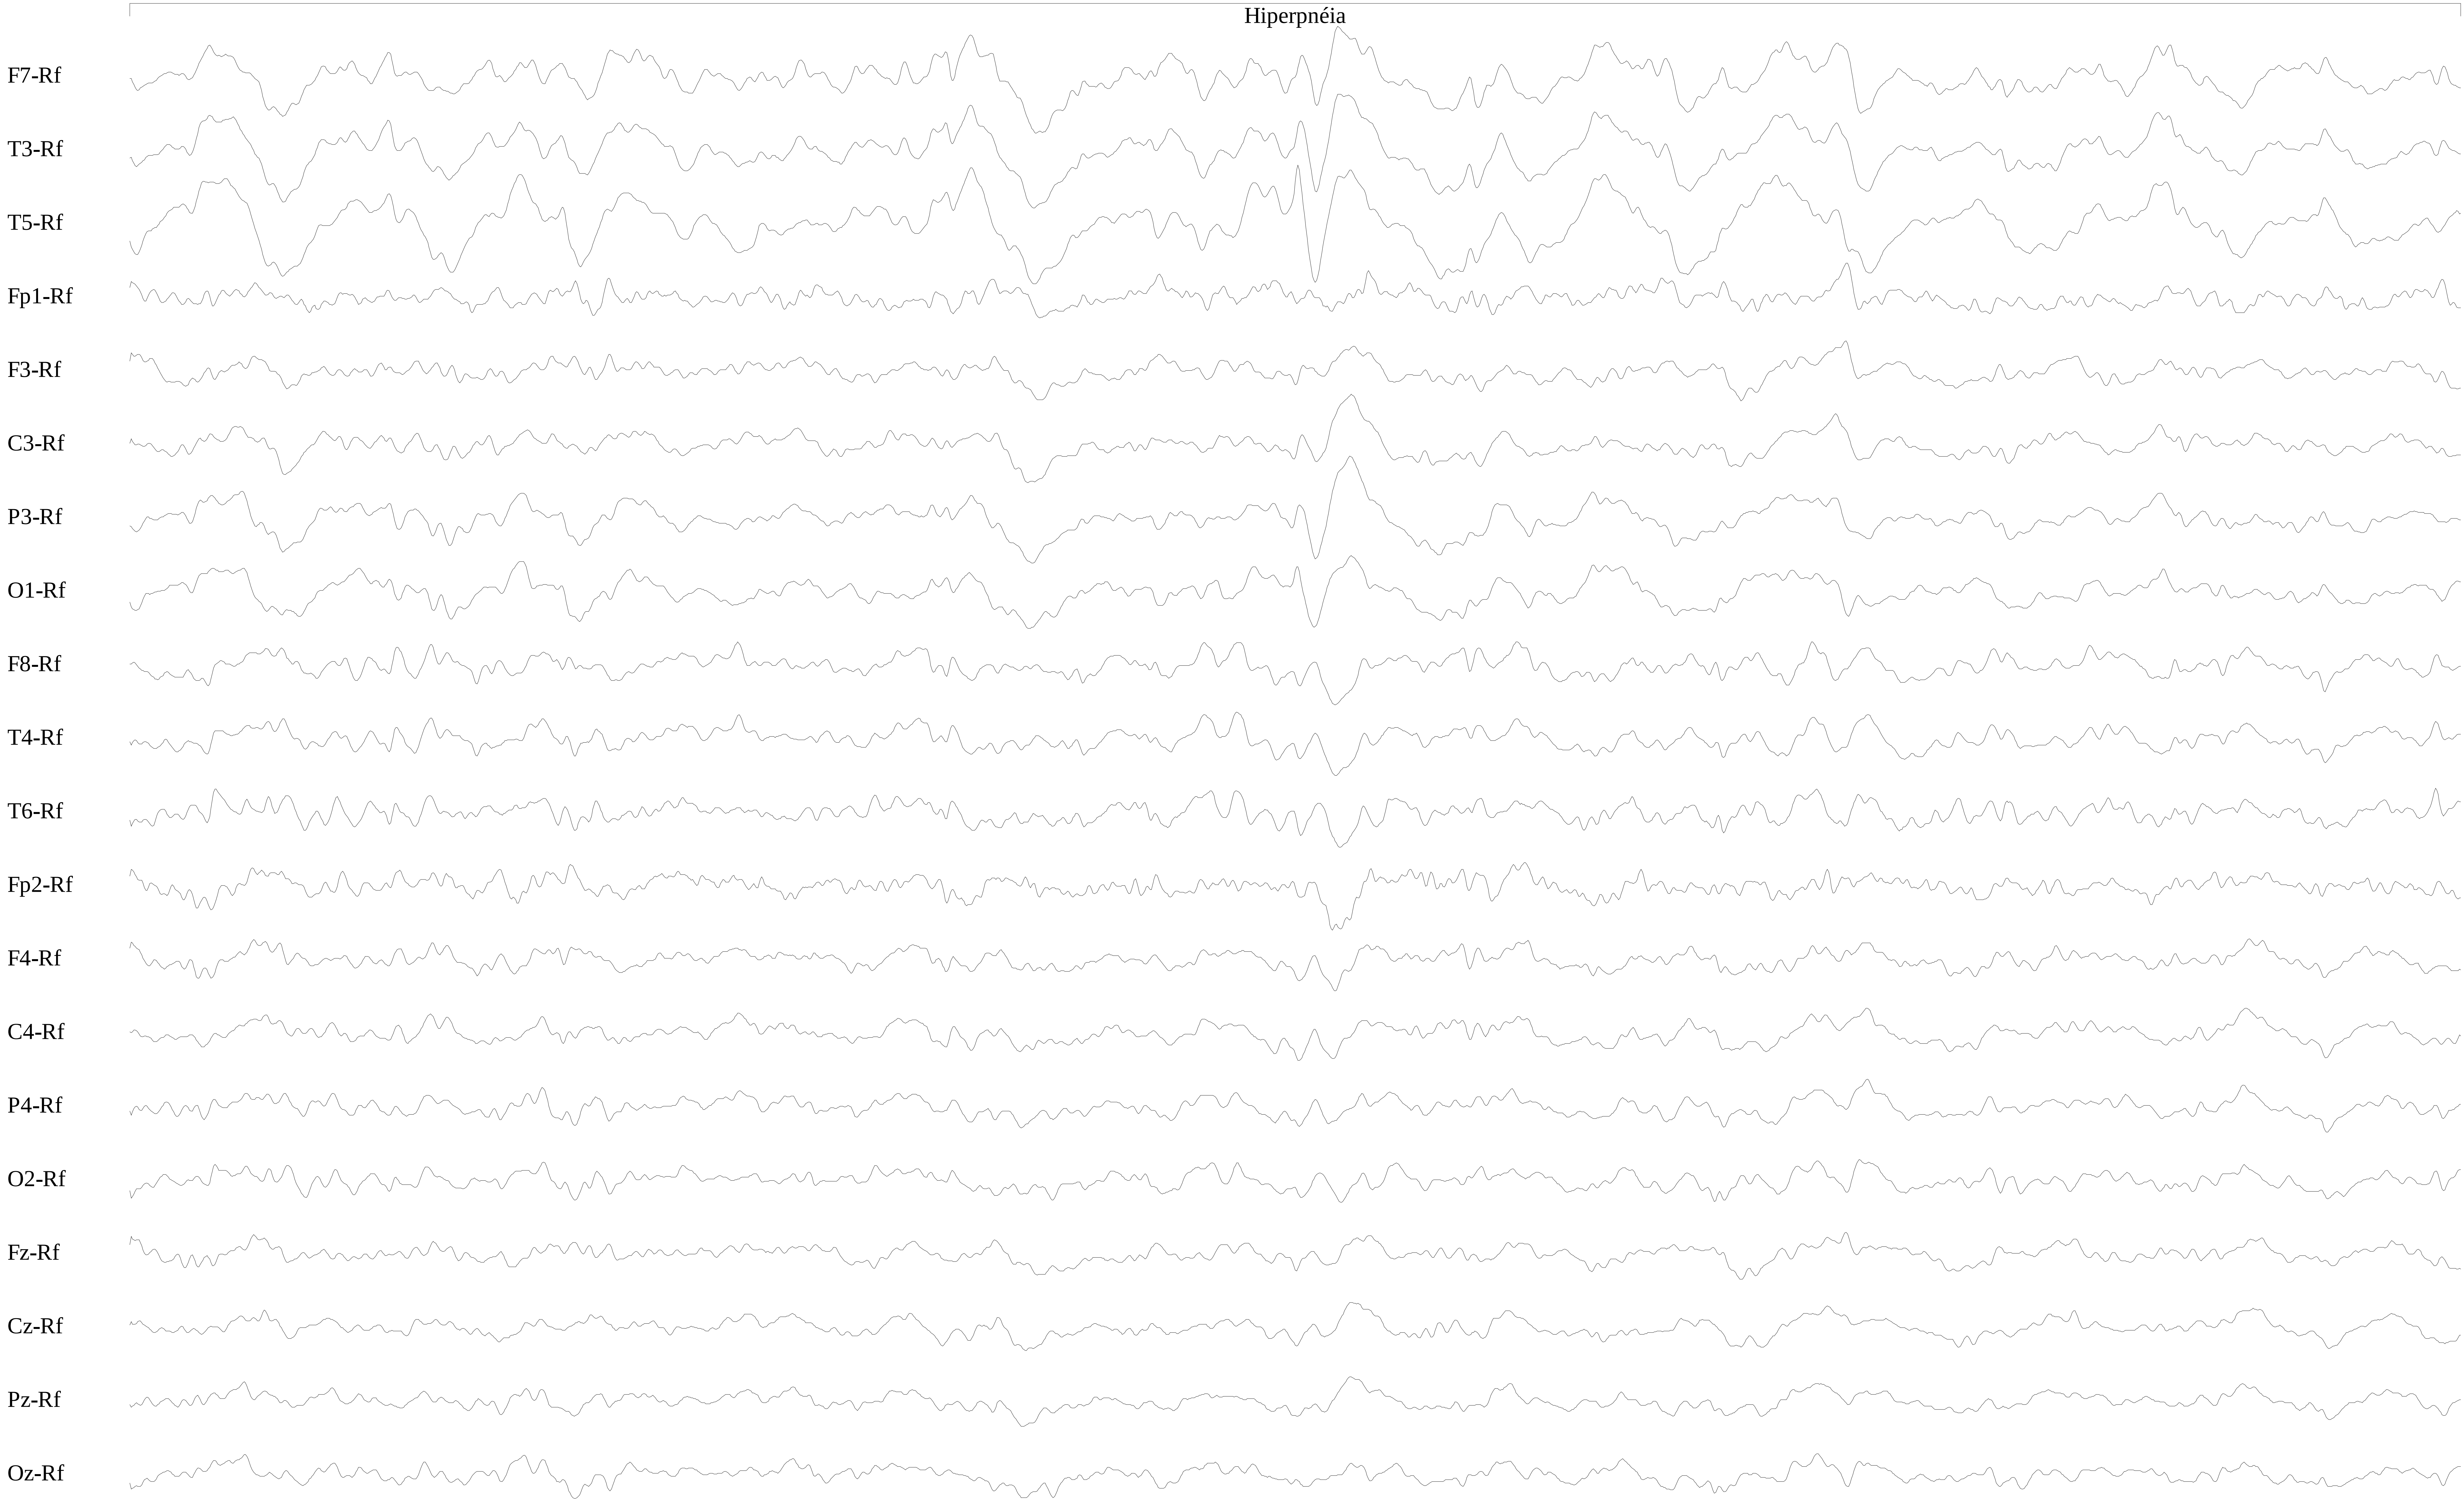
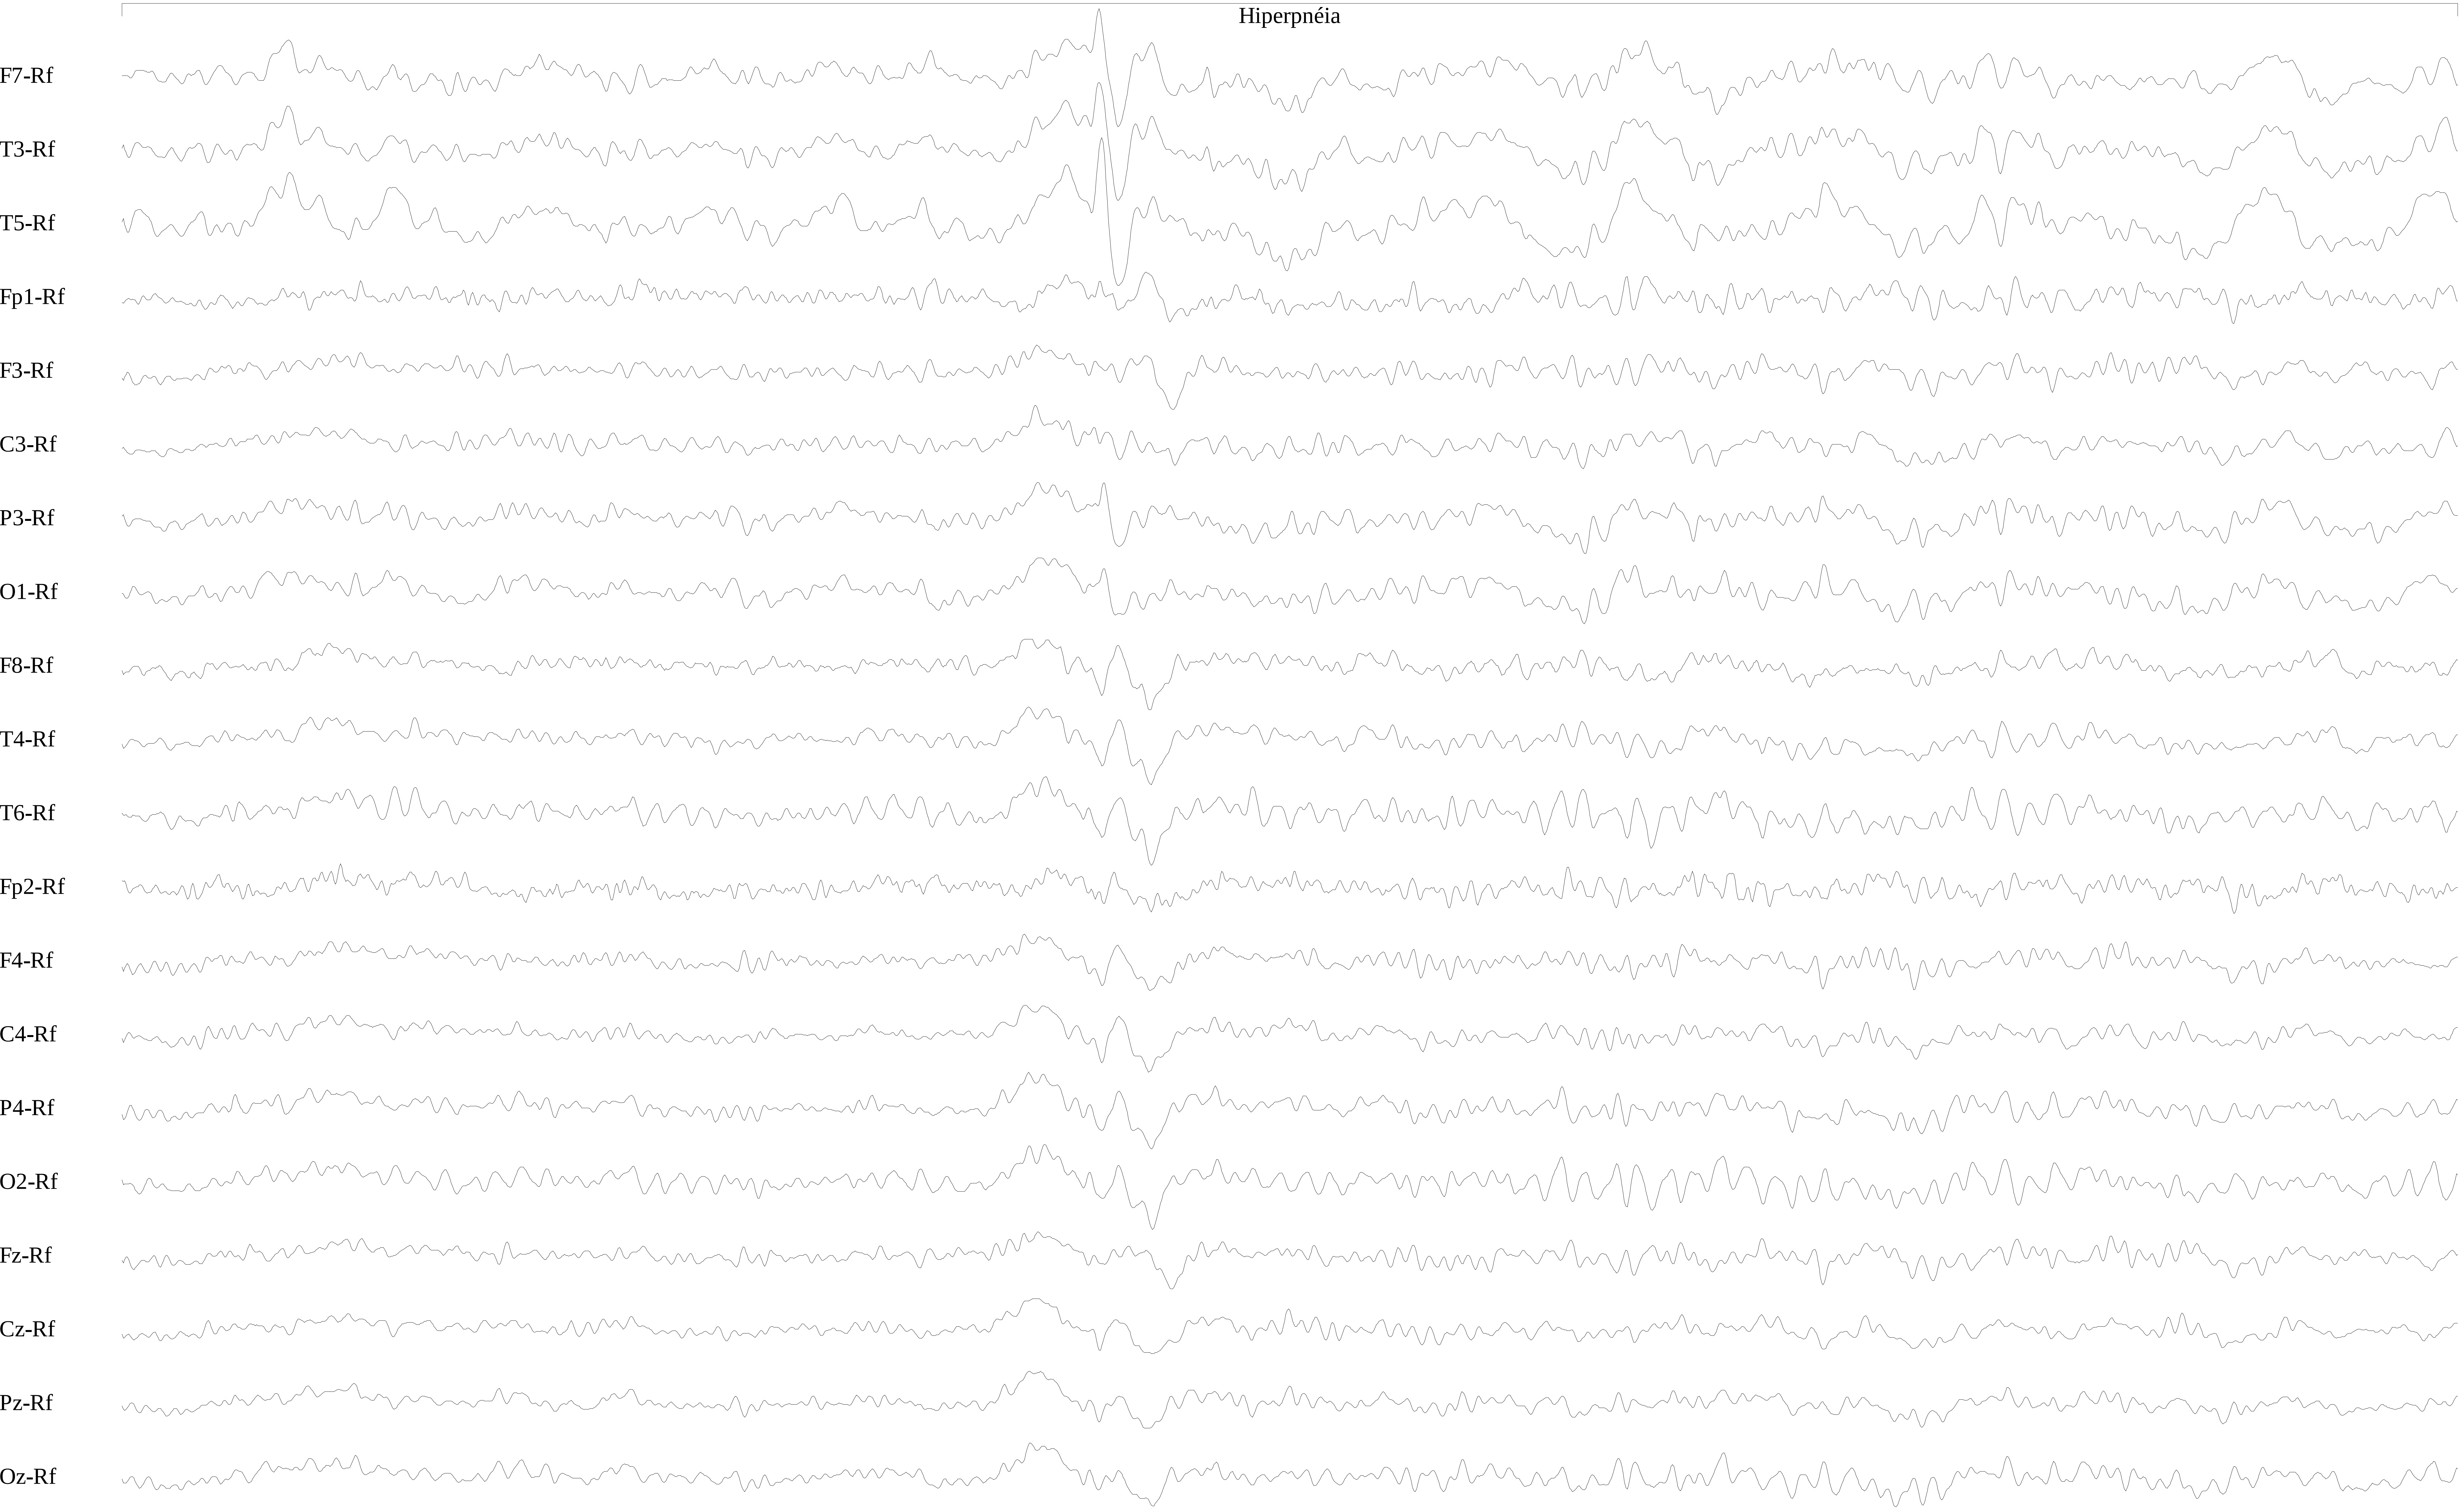
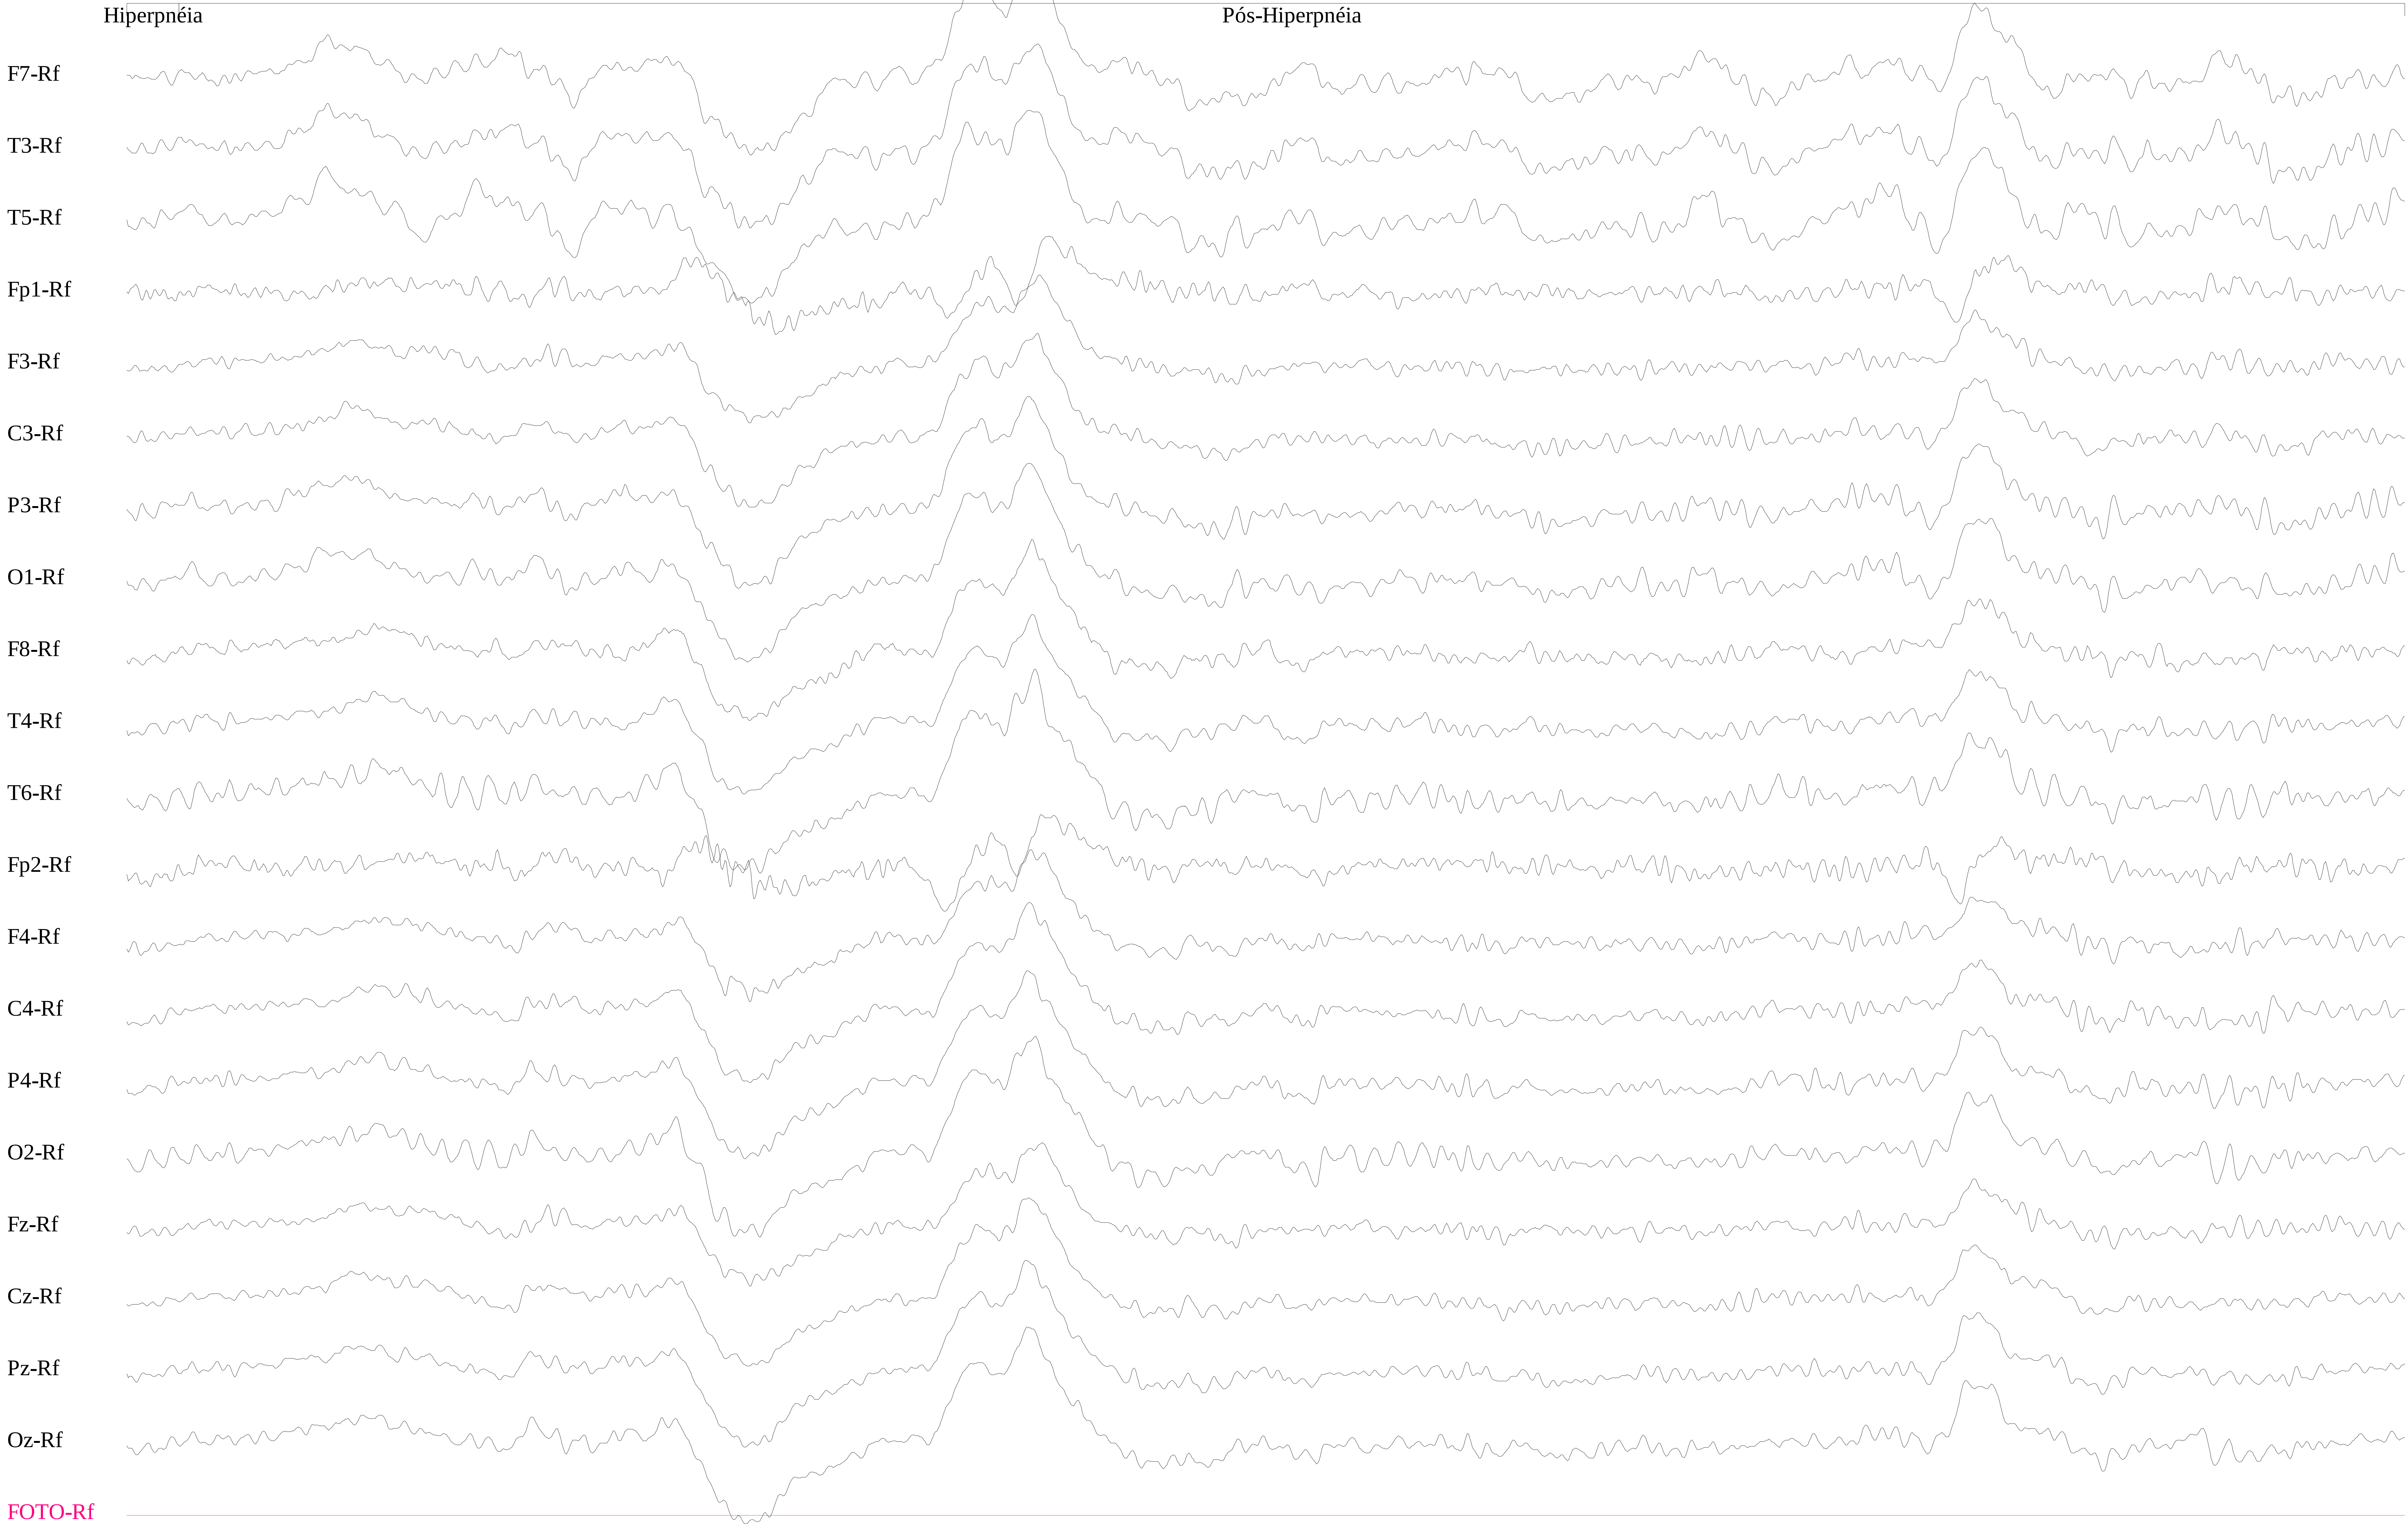


FOTO-Rf









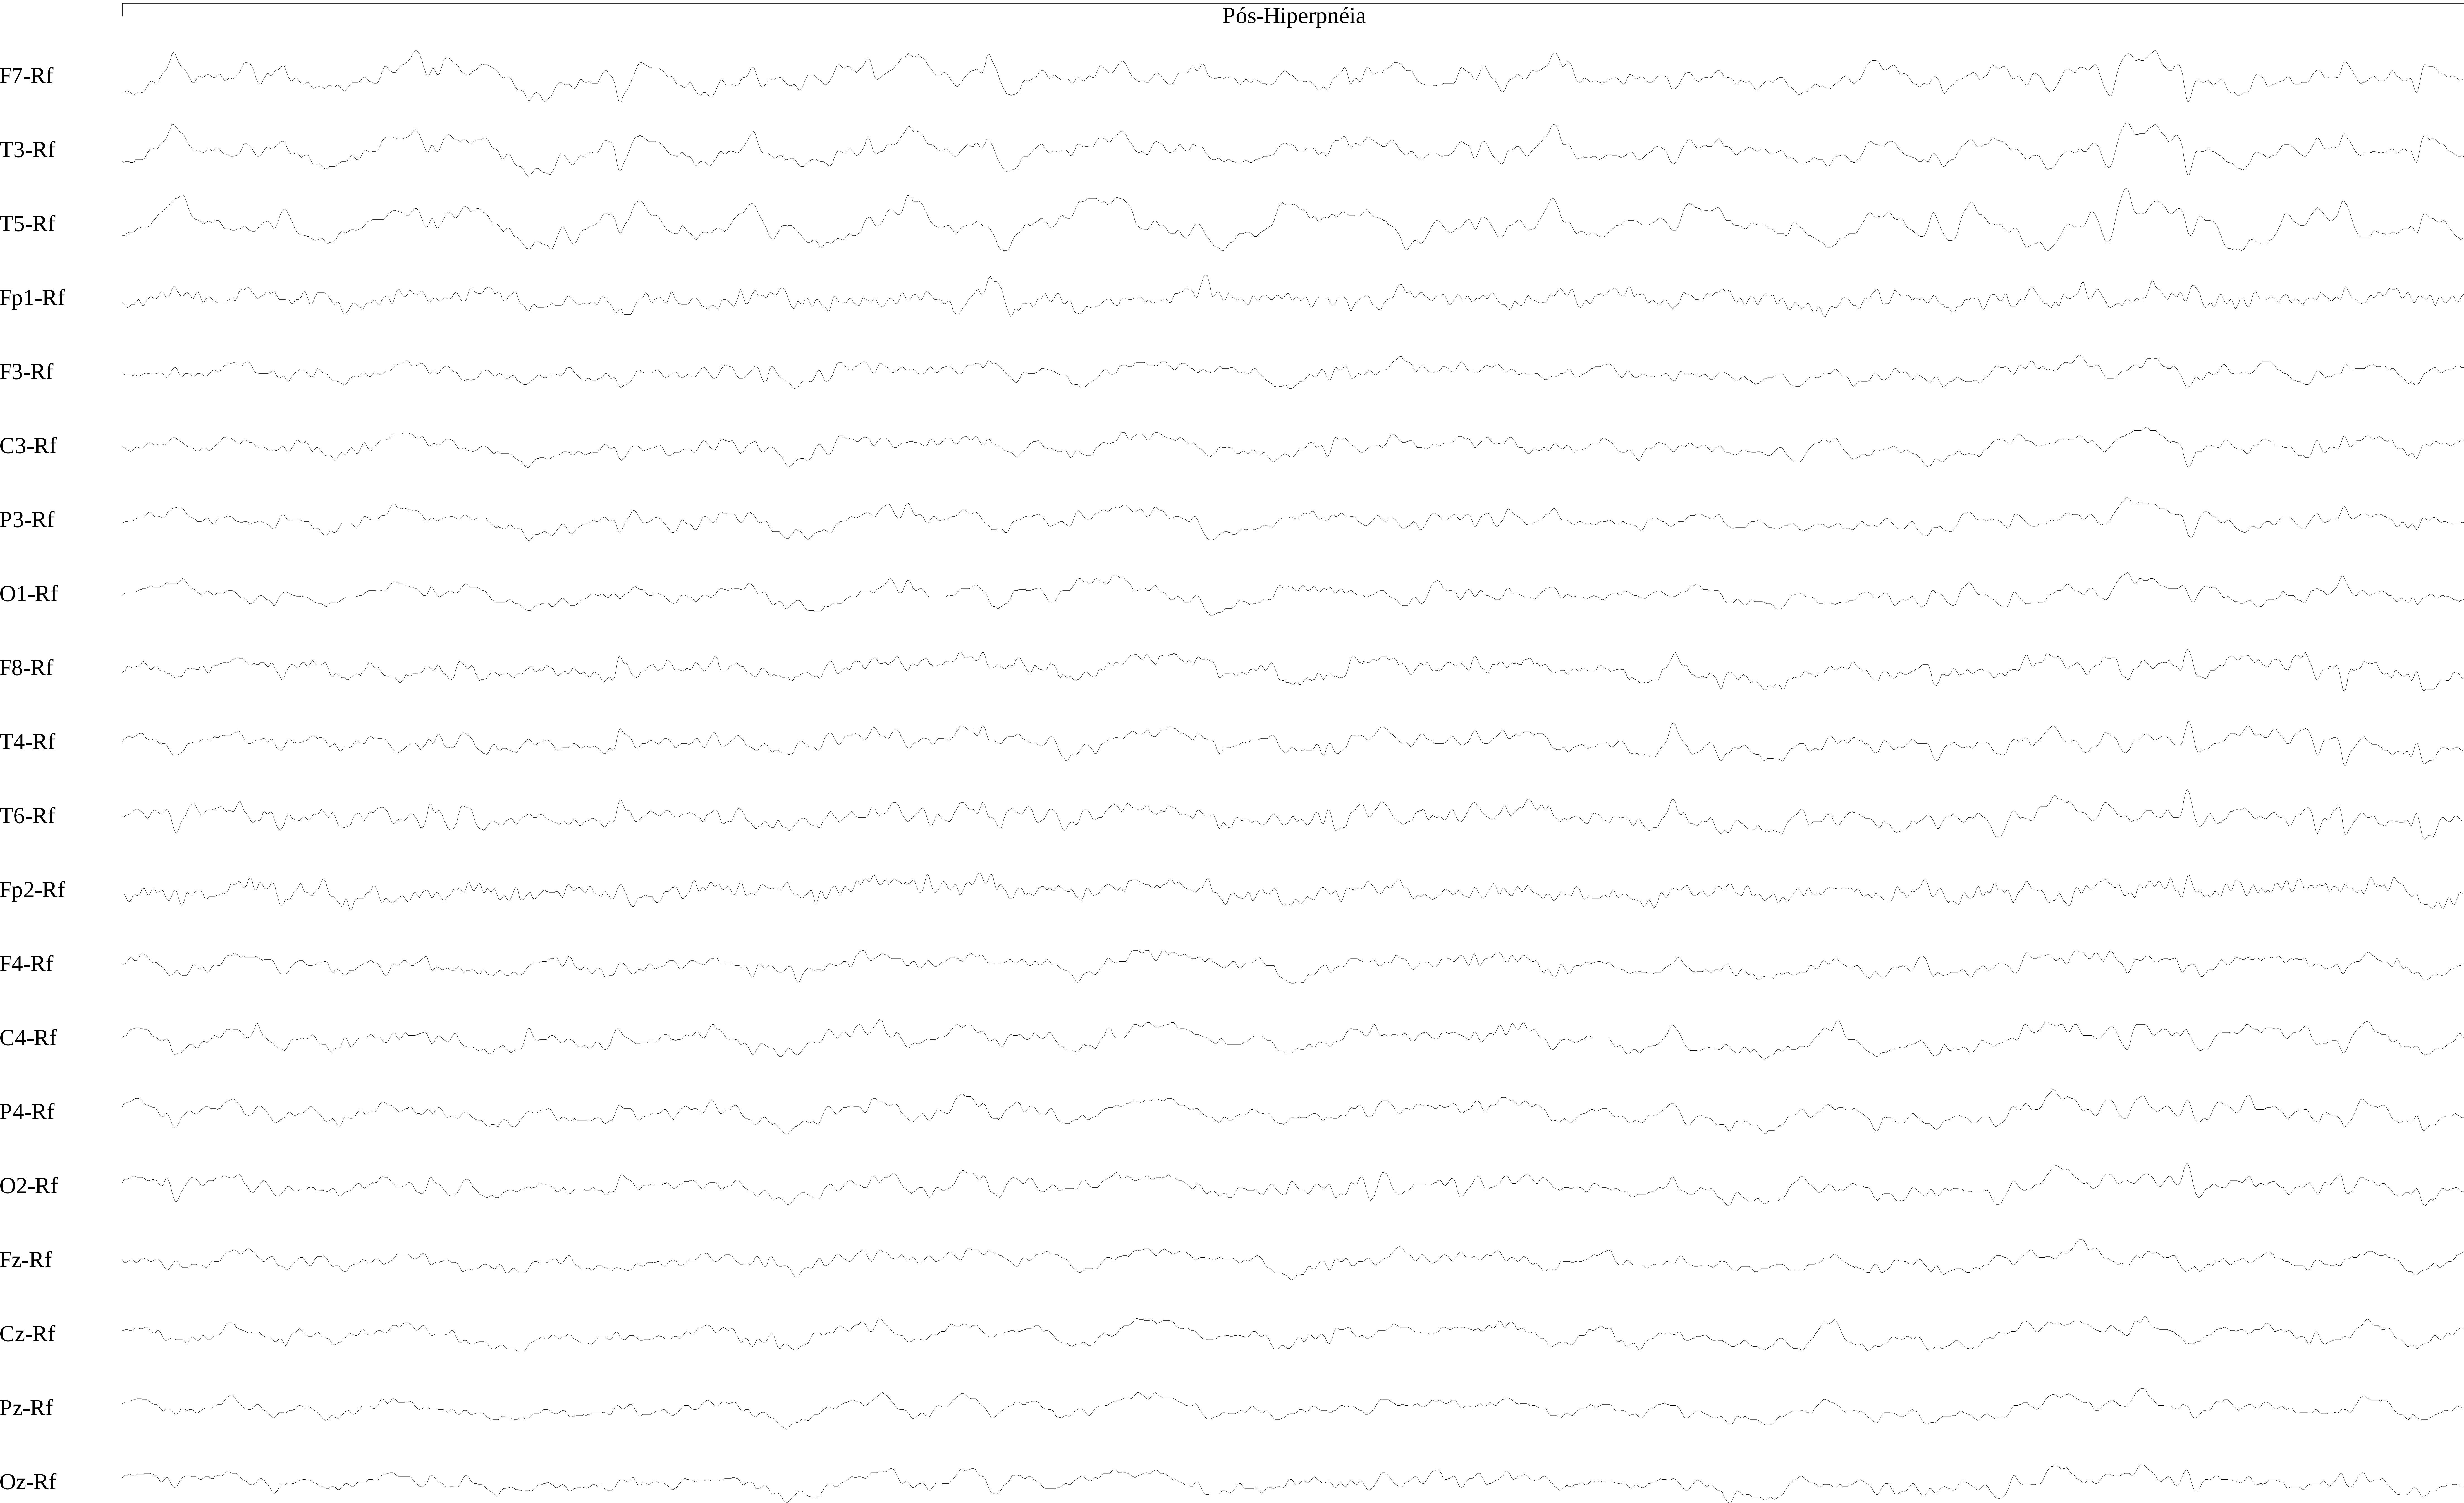


FOTO-Rf



FOTO-Rf